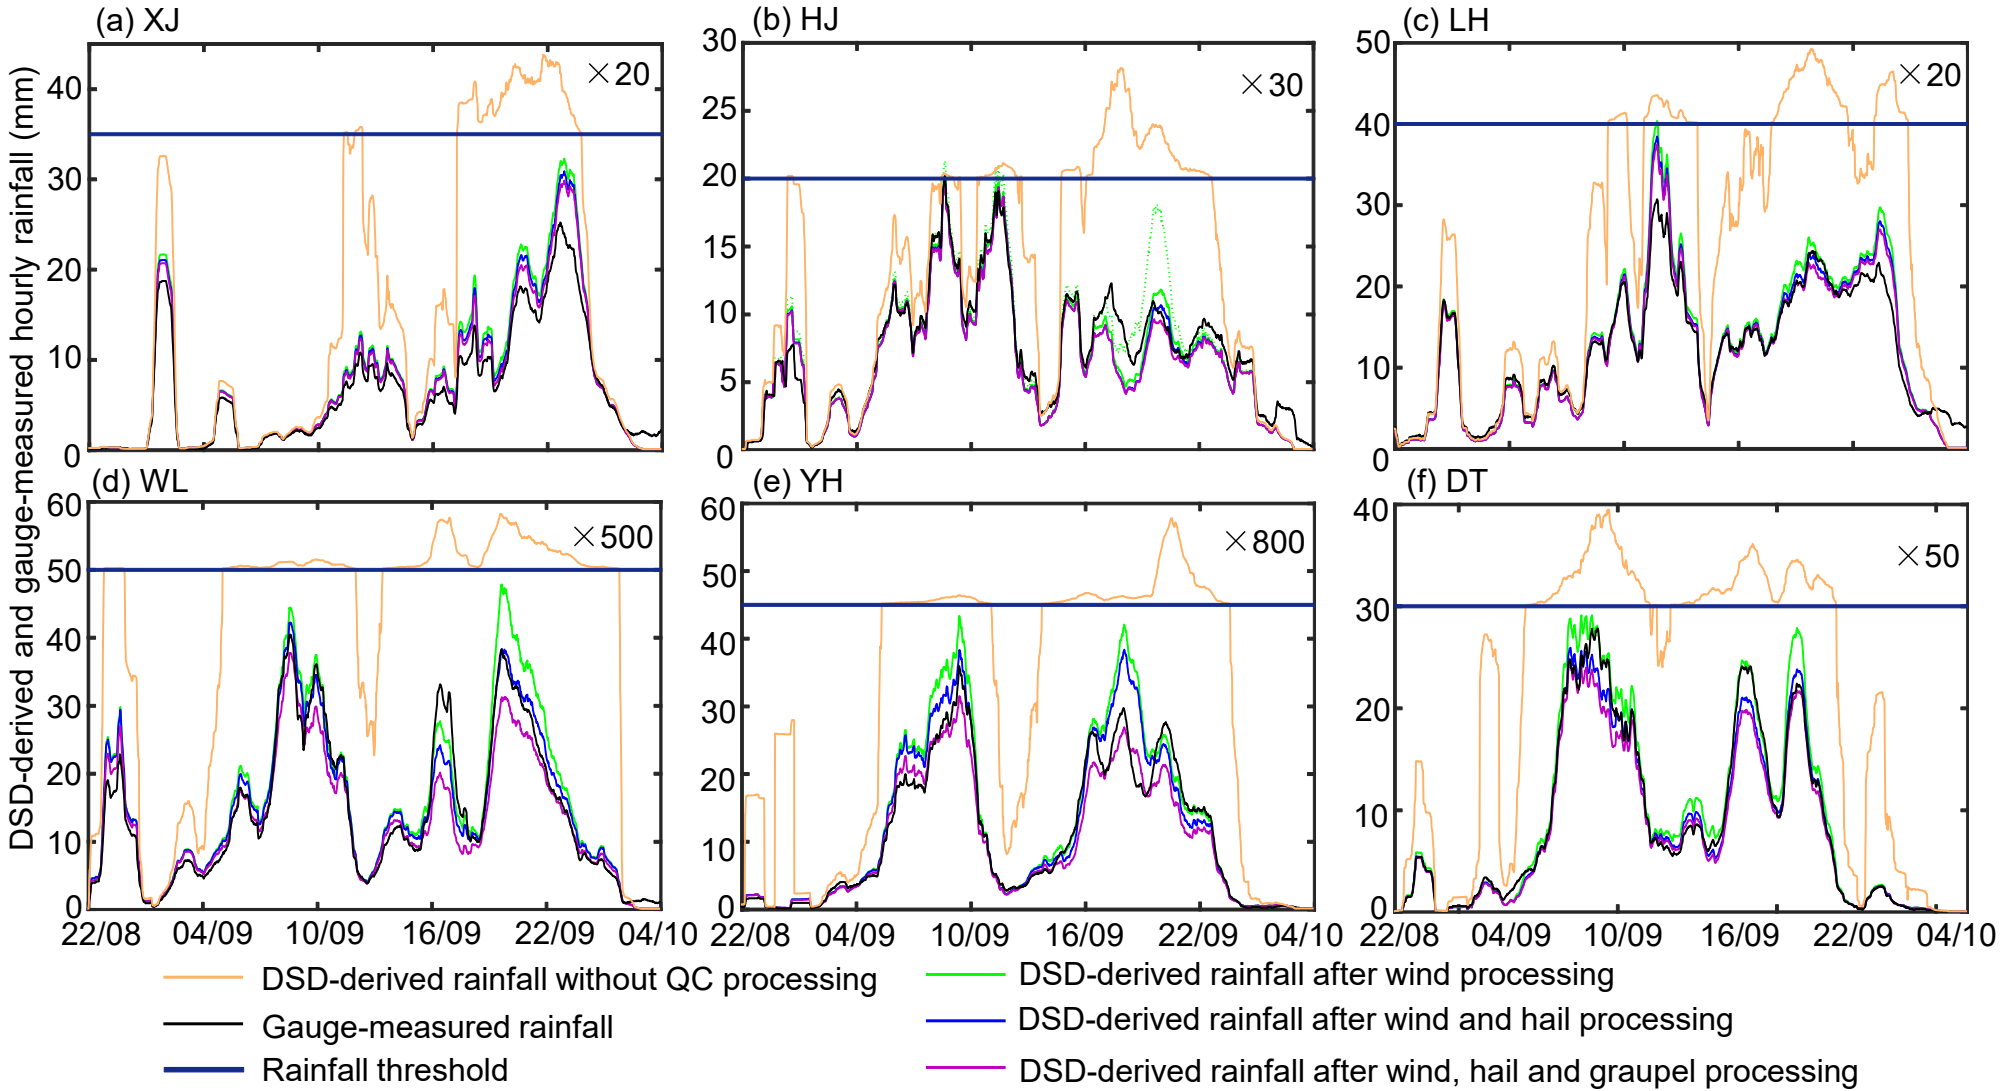
(a) XJ
(b) HJ
(c) LH
(d) WL
(e) YH
(f) DT
×20
×30
×20
×500
×800
×50
DSD-derived and gauge-measured hourly rainfall (mm)
22/08
04/09
10/09
16/09
22/09
04/10
DSD-derived rainfall without QC processing
Gauge-measured rainfall
Rainfall threshold
DSD-derived rainfall after wind processing
DSD-derived rainfall after wind and hail processing
DSD-derived rainfall after wind, hail and graupel processing