

Supplementary information for

“Chemical composition, structures, and light absorption of N-containing aromatic compounds emitted from burning wood and charcoal in household cookstoves”

Mingjie Xie¹, Zhenzhen Zhao¹, Amara L. Holder², Michael D. Hays², Xi Chen², Guofeng Shen³, James J. Jetter², Qin'geng Wang⁴

¹Collaborative Innovation Center of Atmospheric Environment and Equipment Technology, Jiangsu Key Laboratory of Atmospheric Environment Monitoring and Pollution Control, School of Environmental Science and Engineering, Nanjing University of Information Science & Technology, 219 Ningliu Road, Nanjing 210044, China

²Center for Environmental Measurement and Modeling, Office of Research and Development, U.S. Environmental Protection Agency, 109 T.W. Alexander Drive, Research Triangle Park, NC 27711, USA

³Laboratory for Earth Surface Processes, College of Urban and Environmental Sciences, Peking University, Beijing 100871, China

⁴State Key Laboratory of Pollution Control and Resource Reuse, Nanjing University, Nanjing 210023, China

Correspondence to: Mingjie Xie (mingjie.xie@colorado.edu; mingjie.xie@nuist.edu.cn)

Tel: +1-18851903788;

Fax: +86-25-58731051;

Mailing address: 219 Ningliu Road, Nanjing, Jiangsu, 210044, China

S1. Bulk chemical and optical analysis

A thermal-optical instrument (Sunset Laboratory, Portland, OR) running a revised NIOSH 5040 protocol (NIOSH, 1999) was used to measure the OC and EC concentrations. Bulk brown carbon (BrC) absorption of filtered (30 mm diameter. $\times 0.2 \mu\text{m}$ pore size, PTFE filter) methanol extracts was measured using UV/Vis spectrometry. Because the organic carbon (OC) and elemental carbon (EC) emission factors (EFs) at high power phases (cold start-CS, hot start-HS) were substantially greater than the low power simmer (SIM) phase EFs, the BrC absorption from red oak and charcoal burning were primarily measured for CS- and HS-phase samples. The only SIM-phase samples analyzed were for red oak fuel burning in a 3-stone fire, as this was the only test with comparable OC emissions between SIM- and CS-phase combustions, and the CS and HS phases of the 3-stone fire are typically similar and cannot be separated. Xie et al. (2018) characterized the UV-Vis absorption properties of BrC in the methanol extracts, providing the light absorption coefficient (Abs_λ , Mm^{-1}), mass absorption coefficient (MAC_λ , $\text{m}^2 \text{ g}^{-1}$), and solution absorption Ångström exponent (\AA_{abs}). Currently, the concentrations of OC and EC, Abs_{365} , MAC_{365} , and \AA_{abs} of Q_f and Q_b samples collected for red oak and charcoal burning mainly at high power water boiling test (WBT) phases are summarized in Tables S1 and S2 of the supplementary information. The light absorption of OC extracts at 365 nm has been widely used to represent BrC absorption (Chen and Bond, 2010; Hecobian et al., 2010; Liu et al., 2013).

Table S1. Summaries of OC and EC concentrations and light-absorbing properties of OC in Q_f samples for each test fuel-cookstove combination.

Fuel	Cookstove	Test phase	OC mg m ⁻³	EC mg m ⁻³	EC/OC ^a	Extraction ^a (%)	Abs ₃₆₅ ^b Mm ⁻¹ /1000	MAC ₃₆₅ ^a m ² gC ⁻¹	Å _{abs} ^a
<i>Upper filter</i>									
Red Oak	3-Stone fire	CS	1.11 ± 0.12	0.98 ± 0.067	0.90 ± 0.16	94.2 ± 0.60	3.64 ± 0.40	3.48 ± 0.10	5.88 ± 0.25
		SIM	1.09 ± 0.33	0.33 ± 0.089	0.36 ± 0.17	96.9 ± 0.56	2.47 ± 1.26	2.57 ± 0.78	5.19 ± 0.94
EcoChula XXL		CS	0.11 ± 0.017	0.47 ± 0.13	4.39 ± 1.33	93.5 ± 3.02	1.18 ± 0.58	11.3 ± 4.42	3.25 ± 0.35
		HS	0.15 ± 0.056	0.62 ± 0.030	4.69 ± 2.17	71.9 ± 27.2	0.83 ± 0.67	7.64 ± 3.46	4.26 ± 0.96
Envirofit G3300		CS	0.94 ± 0.25	1.43 ± 0.022	1.60 ± 0.43	87.8 ± 4.62	2.72 ± 0.92	3.33 ± 0.72	6.56 ± 0.25
		HS	2.40 ± 1.04	2.73 ± 0.31	1.26 ± 0.45	76.3 ± 3.57	7.10 ± 2.85	3.93 ± 0.33	6.74 ± 0.22
Home Stove		CS	0.15 ± 0.026	0.29 ± 0.056	1.96 ± 0.55	87.5 ± 2.14	0.69 ± 0.18	5.54 ± 2.22	3.59 ± 0.40
		HS	0.21 ± 0.081	0.63 ± 0.14	3.11 ± 0.50	92.8 ± 7.05	0.57 ± 0.14	3.00 ± 0.55	3.43 ± 0.018
Jiko Poa		CS	0.57 ± 0.028	0.70 ± 0.16	1.23 ± 0.32	96.7 ± 0.65	2.30 ± 0.32	4.15 ± 0.60	4.61 ± 0.20
		HS	0.78 ± 0.066	1.25 ± 0.25	1.63 ± 0.43	92.3 ± 1.70	2.51 ± 0.41	3.67 ± 0.72	5.01 ± 0.49
Jiko Poa (HM)		CS	0.86 ± 0.16	0.32 ± 0.11	0.37 ± 0.084	95.4 ± 1.32	2.24 ± 0.56	2.72 ± 0.29	5.06 ± 0.56
		HS	0.82 ± 0.16	0.55 ± 0.20	0.71 ± 0.34	95.9 ± 0.85	3.28 ± 0.45	4.18 ± 0.35	3.99 ± 0.12
Charcoal	CH4400	CS	0.048 ± 0.020	0.39 ± 0.082	8.73 ± 2.66	97.8 ± 3.02	0.12 ± 0.046	2.96 ± 1.73	3.79 ± 0.64
		HS	0.072 ± 0.042	0.0030 ± 0.0010 ^c	0.020 ± 0.019	96.3 ± 5.44	0.14 ± 0.099	1.96 ± 0.39	7.91 ± 1.55
Éclair		CS	0.19 ± 0.068	0.68 ± 0.25	3.67 ± 0.11	95.3 ± 6.18	0.18 ± 0.12	0.93 ± 0.33	6.64 ± 2.20
		HS	0.47 ± 0.022	0.020 ± 0.0044	0.042 ± 0.0094	96.6 ± 1.58	0.72 ± 0.072	1.57 ± 0.18	6.93 ± 0.15
Jiko Koa		CS	0.14 ± 0.095	0.50 ± 0.29	4.69 ± 3.16	95.3 ± 2.24	0.35 ± 0.36	2.31 ± 1.20	4.16 ± 0.79
		HS	0.63 ± 0.31	0.017 ± 0.0074	0.028 ± 0.0039	97.0 ± 0.79	1.03 ± 0.42	1.82 ± 0.44	7.21 ± 0.45
Prakti Leo		CS	0.13 ± 0.063	0.72 ± 0.42	5.64 ± 0.60	97.9 ± 2.44	0.29 ± 0.16	2.30 ± 0.78	4.53 ± 0.99
		HS	0.50 ± 0.092	0.010 ± 0.0020	0.021 ± 0.0038	98.3 ± 0.58	0.80 ± 0.24	1.60 ± 0.31	8.90 ± 0.63
Zoom Jet		CS	0.073 ± 0.013	0.60 ± 0.33	7.89 ± 2.91	91.7 ± 7.07	0.19 ± 0.11	2.65 ± 0.87	3.88 ± 1.12
		HS	0.56 ± 0.35	0.021 ± 0.014	0.036 ± 0.0061	95.5 ± 0.61	0.87 ± 0.47	1.77 ± 0.39	7.64 ± 0.62

^a Data were obtained from Xie et al. (2018); ^b values presented here have been divided by 1000; ^c measurements of only two filter samples were available, the values reported here are average ± difference between the two measurements/2

Table S2. Summaries of OC and EC concentrations and light-absorbing properties of OC in Q_b samples for each test fuel-cookstove combination.

Fuel	Cookstove	Test phase	OC mg m ⁻³	bOC/OC ^a %	Abs365 ^b Mm ⁻¹ /1000	MAC _{365^a} m ² gC ⁻¹	Åabs ^a	Temp. ^c °C
Backup filter								
Red Oak	3-Stone fire	CS	0.13 ± 0.0091	11.9 ± 0.59	0.24 ± 0.0052	1.83 ± 0.12	6.86 ± 0.41	24.6 ± 0.57
		SIM	0.16 ± 0.066	16.2 ± 4.54	0.23 ± 0.055	1.50 ± 0.26	8.34 ± 1.26	24.2 ± 0.57
EcoChula XXL		CS	0.022 ± 0.0024	20.2 ± 0.96	0.064 ± 0.026	2.86 ± 0.94	3.78 ± 0.14	44.1 ± 1.81
		HS	0.027 ± 0.0070	20.1 ± 8.49	0.081 ± 0.0063	3.11 ± 0.81	3.53 ± 1.30	48.3 ± 1.52
Envirofit G3300		CS	0.095 ± 0.023	10.3 ± 1.93	0.17 ± 0.031	1.84 ± 0.33	8.58 ± 2.39	22.4 ± 0.61
		HS	0.15 ± 0.34	6.79 ± 1.56	0.31 ± 0.049	2.08 ± 0.46	6.40 ± 1.62	23.2 ± 0.49
Home Stove		CS	0.028 ± 0.0033	19.1 ± 1.55	0.046 ± 0.015	1.69 ± 0.62	5.59 ± 0.80	22.9 ± 0.62
		HS	0.039 ± 0.0009	20.5 ± 7.59	0.042 ± 0.014	1.05 ± 0.33	6.27 ± 2.39	24.1 ± 0.84
Jiko Poa		CS	0.081 ± 0.0065	14.0 ± 0.61	0.18 ± 0.013	2.23 ± 0.063	6.20 ± 0.36	23.7 ± 0.08
		HS	0.11 ± 0.016	14.2 ± 1.72	0.19 ± 0.061	1.83 ± 0.021	6.94 ± 0.19	24.8 ± 0.35
Jiko Poa (HM)		CS	0.11 ± 0.012	13.2 ± 1.06	0.15 ± 0.012	1.31 ± 0.084	8.23 ± 0.77	23.1 ± 0.16
		HS	0.11 ± 0.018	14.0 ± 0.55	0.16 ± 0.015	1.38 ± 0.21	7.74 ± 0.37	24.1 ± 0.05
Charcoal	CH4400	CS	0.020 ± 0.015	30.0 ± 21.7	0.017 ± 0.0085 ^d	1.36 ± 0.60	6.32 ± 0.18	23.3 ± 0.22
		HS	0.041 ± 0.015	66.0 ± 26.4	0.029 ± 0.026	0.66 ± 0.55	10.5 ± 5.99	23.6 ± 0.27
	Éclair	CS	0.059 ± 0.017	32.7 ± 4.66	0.031 ± 0.028	0.47 ± 0.31	8.44 ± 3.13	23.6 ± 0.51
		HS	0.13 ± 0.0077	27.7 ± 1.72	0.11 ± 0.012	0.83 ± 0.10	8.19 ± 2.63	23.8 ± 0.51
Jiko Koa		CS	0.058 ± 0.031	42.5 ± 7.12	0.057 ± 0.044	0.72 ± 0.26	11.8 ± 8.53	22.0 ± 0.53
		HS	0.21 ± 0.070	38.0 ± 12.8	0.17 ± 0.027	0.88 ± 0.47	10.5 ± 2.82	22.2 ± 0.84
Prakti Leo		CS	0.043 ± 0.010	37.5 ± 9.20	0.028 ± 0.012	0.65 ± 0.21	9.51 ± 3.13	22.6 ± 1.13
		HS	0.15 ± 0.027	30.7 ± 9.98	0.12 ± 0.016	0.81 ± 0.043	8.48 ± 1.03	23.2 ± 0.89
Zoom Jet		CS	0.023 ± 0.0076	32.5 ± 14.2	0.016 ± 0.014	0.96 ± 1.08	7.72 ± 2.23	22.7 ± 0.52
		HS	0.16 ± 0.077	31.6 ± 8.82	0.10 ± 0.077	0.57 ± 0.27	12.3 ± 3.04	23.0 ± 0.56

^aData were obtained from Xie et al. (2018); ^b values presented here have been divided by 1000; ^c sampling temperature; ^d measurements of only two filter samples were available, the values reported here are average ± difference between the two measurements/2

Table S3. Identified N-containing aromatic compounds by HPLC/ESI-Q-ToFMS from solid fuel combustions in cookstoves.

Suggested Formula	Theoretical m/z [M-H] ⁻	Measured m/z [M-H] ⁻	Proposed structure	Quantified as ^b	Absorbing as ^c
C ₆ H ₅ NO ₃	138.0196	138.0194		4-Nitrophenol (C ₆ H ₅ NO ₃)	
C ₇ H ₇ NO ₃ (Iso1 ^a)	152.0353	152.0356		2-Methyl-4-nitrophenol (C ₇ H ₇ NO ₃)	
C ₇ H ₇ NO ₃ (Iso2)	152.0353	152.0361		2-Methyl-4-nitrophenol (C ₇ H ₇ NO ₃)	
C ₆ H ₅ NO ₄	154.0145	154.0146		4-Nitrocatechol (C ₆ H ₅ NO ₄)	
C ₇ H ₇ NO ₄ (Iso1 ^a)	168.0302	168.0304		2-Methyl-4-nitroresorcinol (C ₇ H ₇ NO ₄)	
C ₇ H ₇ NO ₄ (Iso2)	168.0302	168.0302		2-Methyl-4-nitroresorcinol (C ₇ H ₇ NO ₄)	
C ₈ H ₇ NO ₄ (Iso1)	180.0302	180.0304		2-Methyl-5-nitrobenzoic acid (C ₈ H ₇ NO ₄)	

^a Isomer 1; ^b standard compounds used for the quantification of identified N-containing aromatic compounds; ^c standard compounds used to estimate the light absorption of N-containing aromatic compounds.

Table S3. Continue.















Suggested Formula	Theoretical m/z [M-H] ⁻	Measured m/z [M-H] ⁻	Proposed structure	Quantified as	Absorbing as
C ₈ H ₇ NO ₄ (Iso2)	180.0302	180.0303		2-Methyl-5-nitrobenzoic acid (C ₈ H ₇ NO ₄) 	phenyl cyanate (C ₇ H ₅ NO)
C ₈ H ₉ NO ₄	182.0459	182.0460		2-Methyl-4-nitroresorcinol (C ₇ H ₇ NO ₄) 	2-Methyl-4-nitroresorcinol (C ₇ H ₇ NO ₄)
C ₈ H ₅ NO ₂	146.0248	146.0248		2-Methyl-5-nitrobenzoic acid (C ₈ H ₇ NO ₄) 	2-Methyl-5-nitrobenzoic acid (C ₈ H ₇ NO ₄)
C ₇ H ₇ NO ₅	184.0253	184.0258		2-Nitrophloroglucinol (C ₆ H ₅ NO ₅) 	2-Nitrophloroglucinol (C ₆ H ₅ NO ₅)
C ₁₀ H ₇ NO ₃	188.0353	188.0357		2-Nitro-1-naphthol (C ₁₀ H ₇ NO ₃) 	2-Nitro-1-naphthol (C ₁₀ H ₇ NO ₃)
C ₉ H ₉ NO ₄ (Iso1)	194.0458	194.0464		2,5-Dimethyl-4-nitrobenzoic acid (C ₉ H ₉ NO ₄) 	phenyl cyanate (C ₇ H ₅ NO)
C ₉ H ₉ NO ₄ (Iso2)	194.0458	194.0464		2,5-Dimethyl-4-nitrobenzoic acid (C ₉ H ₉ NO ₄) 	2-Methyl-4-nitroresorcinol (C ₇ H ₇ NO ₄)

Table S3. Continue.

Suggested Formula	Theoretical m/z [M-H] ⁻	Measured m/z [M-H] ⁻	Proposed structure	Quantified as	Absorbing as
C ₈ H ₇ NO ₅	196.0251	196.0252		2-Methyl-5-nitrobenzoic acid (C ₈ H ₇ NO ₄)	
C ₈ H ₉ NO ₅	198.0407	198.0413		2-Nitrophloroglucinol (C ₆ H ₅ NO ₅)	
C ₁₁ H ₉ NO ₃	202.0510	202.0492		2-Nitro-1-naphthol (C ₁₀ H ₇ NO ₃)	
C ₁₀ H ₁₁ NO ₄	208.0615	208.0621		2-Nitrophloroglucinol (C ₆ H ₅ NO ₅)	
C ₁₀ H ₁₁ NO ₅	224.0564	224.0592		2-Nitrophloroglucinol (C ₆ H ₅ NO ₅)	
C ₁₁ H ₁₃ NO ₅	238.0721	238.0722		2-Nitrophloroglucinol (C ₆ H ₅ NO ₅)	
C ₁₁ H ₁₃ NO ₆	254.0670	254.0670		2-Nitrophloroglucinol (C ₆ H ₅ NO ₅)	

Table S4. MAC_{365,iNAC} (m² g⁻¹) values for identified NAC formulas.

Formula	MW (M-H) ⁻	MAC _{365,iNAC} ^a
C6H5NO3	138.0197	2.44
C7H7NO3	152.0353	3.15
C6H5NO4	154.0146	7.02
C7H7NO4	168.0302	12.9
C8H7NO4	180.0302	0
C8H9NO4	182.0459	12.9
C8H5NO2	146.0248	0.35
C7H7NO5	184.0251	14.0
C10H7NO3	188.0353	3.75
C9H9NO4	194.0459	12.9 ^b
C8H7NO5	196.0251	12.9
C8H9NO5	198.0407	14.0
C11H9NO3	202.051	3.75
C10H11NO4	208.0615	0
C10H11NO5	224.0564	14.0
C11H13NO5	238.0721	0
C11H13NO6	254.067	0

^a Obtained from Xie et al. (2017, 2019); ^b value for the second isomer, and the MAC_{365,iNAC} of the first isomer is set at 0 based on its structure.

Table S5. Average mass ratios (%) of individual NACs to OC (iNACoc%) in Q_f samples for burning red oak in different household cookstoves.

Compound	3-Stone fire		EcoChula XXL		Envirofit G3300	
	CS	SIM	CS	HS	CS	HS
C6H5NO3	0.0054 ± 0.0009	0.0026 ± 0.0014	0.33 ± 0.069	0.33 ± 0.10	0.0015 ± 0.0012 ^b	0.0018 ± 0.0015 ^b
C7H7NO3	0.0008 ^a	/	0.028 ± 0.0068	0.029 ± 0.010	0.0032 ^a	/
C6H5NO4	0.040 ± 0.11	0.053 ± 0.057	0.082 ± 0.036	0.092 ± 0.050	0.024 ± 0.0062	0.021 ± 0.0052
C7H7NO4	0.018 ± 0.0075	0.020 ± 0.021	0.010 ± 0.0066	0.011 ± 0.010	0.0088 ± 0.0018	0.0097 ± 0.0069
C8H7NO4	0.034 ± 0.018	0.021 ± 0.0095 ^b	0.021 ± 0.0030	0.021 ± 0.012	0.028 ± 0.0051	0.014 ± 0.0052
C8H9NO4	0.012 ± 0.0046	0.012 ± 0.0066	0.0030 ± 0.0013	0.0045 ± 0.0020	0.0038 ± 0.0017	0.0035 ± 0.0052
C8H5NO2	/	/	/	/	/	/
C7H7NO5	0.0014 ± 0.0006	0.0048 ± 0.0050	/	/	/	/
C10H7NO3	0.11 ± 0.026	0.037 ± 0.031	2.16 ± 0.35	2.04 ± 0.55	0.15 ± 0.068	0.087 ± 0.041
C9H9NO4	0.031 ± 0.012	0.020 ± 0.010	0.071 ± 0.035	0.051 ± 0.021	0.046 ± 0.013	0.015 ± 0.0052
C8H7NO5	0.0051 ^a	/	0.026 ± 0.0047	0.029 ± 0.018	0.058 ± 0.026	0.016 ± 0.010
C8H9NO5	0.0094 ± 0.0053	0.012 ± 0.0095	0.071 ± 0.016	0.080 ± 0.050	0.011 ± 0.0040	0.0046 ± 0.0017
C11H9NO3	0.10 ± 0.057	0.034 ^a	0.42 ± 0.10	0.38 ± 0.082	0.056 ± 0.019	0.044 ± 0.018
C10H11NO4	0.0069 ± 0.0047	0.0046 ± 0.0013	0.0042 ± 0.0013 ^b	0.020 ^a	0.013 ± 0.0068	0.0030 ± 0.0020
C10H11NO5	0.030 ± 0.0090	0.028 ± 0.014	/	0.015 ^a	/	/
C11H13NO5	0.036 ± 0.016	0.062 ± 0.042	0.0028 ^a	0.015 ^a	0.0006 ^a	/
C11H13NO6	0.0064 ± 0.0050	0.0008 ± 0.0008	0.0096 ± 0.0013	0.0040 ± 0.0014 ^b	/	/
Subtotal	0.44 ± 0.17	0.28 ± 0.18	3.23 ± 0.50	3.09 ± 0.81	0.40 ± 0.14	0.22 ± 0.088
OC ($\mu\text{g m}^{-3}$)	1113 ± 122	1090 ± 732	110 ± 16.5	149 ± 55.6	936 ± 248	2395 ± 1042

^aThe compound was detected in only one of the three filter samples; ^bthe compound was detected in two of the three filter samples or only two out of the three filters were available for measurement, the values reported here are average ± difference between the two measurements/2.

Table S5. Continue

Compound	Home Stove		Jiko Poa		Jiko Poa (HM)	
	CS	HS	CS	HS	CS	HS
C6H5NO3	0.0028 ± 0.0007 ^b	0.0040 ± 0.0021 ^b	0.0023 ± 0.0017	0.0027 ^a	0.0011 ± 0.0004 ^b	0.0024 ± 0.0007 ^b
C7H7NO3	0.0024 ^a	0.0012 ± 0.0007 ^b	0.0005 ± 0.0001	0.0004 ± 0.0001 ^b	0.0002 ± 0.0000 ^b	/
C6H5NO4	0.041 ± 0.0009	0.044 ± 0.027	0.029 ± 0.0059	0.034 ± 0.0067 ^b	0.029 ± 0.011	0.044 ± 0.021
C7H7NO4	0.026 ± 0.0094	0.010 ± 0.0074	0.011 ± 0.0022	0.013 ± 0.0025 ^b	0.0096 ± 0.0022	0.016 ± 0.0056
C8H7NO4	0.039 ± 0.012	0.011 ± 0.0022 ^b	0.049 ± 0.014	0.061 ± 0.028 ^b	0.031 ± 0.0039 ^b	0.021 ± 0.011
C8H9NO4	0.020 ± 0.013	0.0023 ± 0.0018	0.0093 ± 0.0012	0.0085 ± 0.0036 ^b	0.0071 ± 0.0022	0.010 ± 0.0023
C8H5NO2	/	/	0.028 ± 0.017	0.046 ± 0.012 ^b	0.0008 ± 0.0001	0.0036 ± 0.0016
C7H7NO5	0.0077 ± 0.0025 ^b	0.0021 ^a	0.0069 ± 0.0022	0.0029 ± 0.0008 ^b	0.0061 ± 0.0019	0.0075 ± 0.0036
C10H7NO3	0.13 ± 0.10	0.12 ± 0.071	0.093 ± 0.023	0.12 ± 0.017 ^b	0.051 ± 0.0092	0.090 ± 0.034
C9H9NO4	0.12 ± 0.034	0.085 ± 0.029	0.060 ± 0.015	0.060 ± 0.023 ^b	0.057 ± 0.027	0.050 ± 0.026
C8H7NO5	0.10 ± 0.075	0.11 ± 0.0061	0.027 ± 0.019	0.037 ± 0.0072 ^b	0.0028 ^a	0.0059 ± 0.0045
C8H9NO5	0.10 ± 0.046	0.098 ± 0.087	0.018 ± 0.0061	0.026 ± 0.0096 ^b	0.0097 ± 0.0020	0.021 ± 0.0093
C11H9NO3	0.086 ± 0.054	0.057 ± 0.024 ^b	0.057 ± 0.0064	0.072 ± 0.028 ^b	0.026 ± 0.0036	0.056 ± 0.019
C10H11NO4	0.024 ± 0.0024	0.047 ± 0.030	0.016 ± 0.0089	0.016 ± 0.0045 ^b	0.0093 ± 0.0043	0.013 ± 0.0067
C10H11NO5	0.085 ± 0.047	0.040 ± 0.020	0.046 ± 0.022	0.045 ± 0.016 ^b	0.075 ± 0.038	0.10 ± 0.066
C11H13NO5	0.072 ± 0.017	0.099 ± 0.081	0.031 ± 0.0025	0.029 ± 0.0064 ^b	0.085 ± 0.060	0.13 ± 0.098
C11H13NO6	0.026 ± 0.0066	0.035 ± 0.032	0.0066 ± 0.0035	0.013 ± 0.0010 ^b	0.0045 ± 0.0030	0.016 ± 0.014
Subtotal	0.89 ± 0.21	0.74 ± 0.40	0.49 ± 0.095	0.58 ± 0.095 ^b	0.39 ± 0.18	0.58 ± 0.31
OC (µg m ⁻³)	149 ± 25.6	212 ± 80.7	574 ± 27.7	776 ± 66.0	861 ± 161	824 ± 164

Table S6. Average mass ratios (%) of individual NACs to OC (iNACoc%) in Q_b samples for burning red oak in different household cookstoves.

Compound	3-stone fire		EcoChula XXL		Envirofit G3300	
	CS	HS	CS	HS	CS	HS
C6H5NO3	0.0052 ^a	0.0038 ± 0.0040	0.77 ± 0.16	0.75 ± 0.12	0.0049 ± 0.0035 ^b	0.011 ^a
C7H7NO3	/	/	0.077 ± 0.027	0.077 ± 0.0094	0.032 ^a	
C6H5NO4	0.17 ± 0.018	0.21 ± 0.19	0.37 ± 0.20	0.90 ± 0.94	0.091 ± 0.016	0.14 ± 0.036
C7H7NO4	0.10 ± 0.039	0.11 ± 0.085	0.033 ± 0.023	0.046 ± 0.042	0.095 ± 0.024	0.16 ± 0.050
C8H7NO4	0.090 ± 0.046	0.015 ± 0.011	0.026 ^a	0.023 ^a	0.12 ± 0.0077	0.14 ± 0.055
C8H9NO4	0.057 ± 0.0011	0.074 ± 0.022	0.013 ± 0.0034	0.015 ± 0.012	0.047 ± 0.022	0.099 ± 0.078
C8H5NO2	/	/	/	/	/	/
C7H7NO5	0.021 ± 0.0047	0.033 ± 0.033	/	/	/	/
C10H7NO3	0.25 ± 0.11	0.076 ± 0.10	7.27 ± 2.60	4.21 ± 1.73	0.22 ± 0.12	0.18 ± 0.22
C9H9NO4	0.17 ± 0.081	0.14 ± 0.13	0.21 ± 0.11	0.20 ± 0.19	0.27 ± 0.050	0.14 ± 0.041
C8H7NO5	0.023 ± 0.0058	0.019 ± 0.0050	0.15 ± 0.053	0.13 ± 0.026	0.33 ± 0.12	0.082 ± 0.061
C8H9NO5	0.071 ± 0.034	0.073 ± 0.040	0.33 ± 0.12	0.32 ± 0.22	0.055 ± 0.028	0.031 ± 0.012
C11H9NO3	0.50 ± 0.24	0.10 ± 0.096	1.11 ± 0.78	1.37 ± 0.31	0.26 ± 0.089	0.25 ± 0.17
C10H11NO4	0.047 ± 0.031	0.041 ± 0.025	0.021 ± 0.015	0.039 ± 0.063	0.052 ± 0.017	0.013 ± 0.0043
C10H11NO5	0.25 ± 0.11	0.45 ± 0.40	/	/	/	/
C11H13NO5	0.11 ± 0.070	0.33 ± 0.33	0.017 ^a	/	0.0008 ^a	/
C11H13NO6	0.0009 ± 0.0004	0.0060 ± 0.0053 ^b	/	/	/	/
Subtotal	1.86 ± 0.76	1.67 ± 0.88	10.4 ± 2.94	8.70 ± 1.78	1.56 ± 0.35	1.23 ± 0.45
OC (µg m ⁻³)	132 ± 9.14	157 ± 66.3	22.1 ± 2.44	27.2 ± 6.99	95.3 ± 22.9	152 ± 34.0

^aThe compound was detected in only one of the three filter samples; ^bthe compound was detected in two of the three filter samples or only two out of the three filters were available for measurement, the values reported here are average ± difference between the two measurements/2.

Table S6. Continue

Compound	Home Stove		Jiko Poa		Jiko Poa (HM)	
	CS	HS	CS	HS	CS	HS
C6H5NO3	0.013 ± 0.012 ^b	0.0031 ± 0.0009 ^b	0.0068 ± 0.0028	0.0059 ^a	0.00050 ^a	0.0023 ± 0.0017 ^b
C7H7NO3	/	/	0.0013 ± 0.0002	0.0010 ± 0.0009 ^b	/	/
C6H5NO4	0.13 ± 0.016	0.12 ± 0.035	0.10 ± 0.027	0.11 ± 0.088 ^b	0.13 ± 0.044	0.21 ± 0.093
C7H7NO4	0.069 ± 0.055	0.024 ± 0.0070	0.072 ± 0.012	0.063 ± 0.055 ^b	0.067 ± 0.014	0.090 ± 0.0052
C8H7NO4	0.063 ± 0.018 ^b	/	0.20 ± 0.074	0.20 ± 0.16 ^b	0.11 ± 0.015 ^b	0.054 ± 0.039
C8H9NO4	0.052 ± 0.051	0.0042 ± 0.0025	0.068 ± 0.0068	0.053 ± 0.038 ^b	0.052 ± 0.026	0.053 ± 0.018
C8H5NO2	/	/	0.0033 ± 0.0003 ^b	0.016 ± 0.011 ^b	0.00057 ^a	/
C7H7NO5	0.018 ± 0.0079 ^b	0.0045 ^a	0.010 ± 0.0008	0.0073 ± 0.0035 ^b	0.024 ± 0.0034	0.037 ± 0.014
C10H7NO3	0.43 ± 0.46	0.20 ± 0.15	0.10 ± 0.0030	0.10 ± 0.060 ^b	0.051 ± 0.0018	0.12 ± 0.031
C9H9NO4	0.49 ± 0.20	0.35 ± 0.082	0.23 ± 0.075	0.24 ± 0.099 ^b	0.20 ± 0.091	0.23 ± 0.14
C8H7NO5	0.46 ± 0.22	0.35 ± 0.18	0.077 ± 0.026	0.10 ± 0.011 ^b	0.023 ± 0.019	0.034 ± 0.016
C8H9NO5	0.45 ± 0.13	0.29 ± 0.030	0.053 ± 0.0046	0.074 ± 0.050 ^b	0.070 ± 0.034	0.088 ± 0.012
C11H9NO3	0.31 ± 0.18	0.11 ± 0.050 ^b	0.27 ± 0.023	0.27 ± 0.17 ^b	0.12 ± 0.0063	0.20 ± 0.016
C10H11NO4	0.094 ± 0.0035	0.11 ± 0.067	0.031 ± 0.018	0.041 ± 0.015 ^b	0.038 ± 0.024	0.052 ± 0.039
C10H11NO5	0.28 ± 0.13	0.13 ± 0.041	0.24 ± 0.059	0.23 ± 0.15 ^b	0.47 ± 0.17	0.43 ± 0.21
C11H13NO5	0.12 ± 0.069	0.064 ± 0.043	0.048 ± 0.012	0.048 ± 0.014 ^b	0.29 ± 0.23	0.28 ± 0.22
C11H13NO6	/	0.0050 ^a	0.0007 ± 0.0003	0.0012 ^a	0.0033 ± 0.0028	0.0030 ± 0.0013
Subtotal	2.96 ± 0.82	1.74 ± 0.21	1.52 ± 0.30	1.55 ± 0.41 ^b	1.61 ± 0.54	1.87 ± 0.75
OC (µg m ⁻³)	28.1 ± 3.25	39.5 ± 0.92	80.6 ± 6.49	110 ± 15.7	113 ± 12.3	115 ± 17.9

Table S7. Average mass ratios (%) of individual NACs to OC (iNACoc%) in Q_f samples for burning charcoal in different household cookstoves.

Compound	CH4400		Éclair		Jiko Koa	
	CS	HS	CS	HS	CS	HS
C6H5NO3	0.047 ± 0.042	0.055 ± 0.035 ^b	0.010 ± 0.0037	0.0035 ± 0.0025	0.0062 ± 0.0067	0.0027 ± 0.0008
C7H7NO3	0.0090 ± 0.0053	0.0073 ± 0.0032	0.0027 ± 0.0014	0.0011 ^a	0.0038 ± 0.0002 ^b	0.0011 ^a
C6H5NO4	/	0.030 ^a	0.019 ± 0.0025 ^b	0.041 ± 0.0038	0.073 ^a	0.033 ± 0.022
C7H7NO4	0.0045 ^a	0.0024 ^a	0.0030 ± 0.0005	0.024 ± 0.0035	0.040 ± 0.038 ^b	0.025 ± 0.028
C8H7NO4	/	/	/	0.0066 ^a	/	/
C8H9NO4	0.0015 ± 0.0008 ^b	0.0023 ± 0.0016 ^b	0.0041 ± 0.0004 ^b	0.029 ± 0.0094	0.034 ± 0.032 ^b	0.025 ± 0.030
C8H5NO2	/	/	0.017 ± 0.014	0.0041 ± 0.0033	/	/
C7H7NO5	/	/	0.00075 ^a	0.0056 ± 0.0031	0.011 ^a	0.0046 ± 0.0035 ^b
C10H7NO3	0.17 ± 0.13	0.17 ± 0.041	0.077 ± 0.047	0.016 ± 0.011	0.055 ± 0.018	0.018 ± 0.016
C9H9NO4	0.010 ^a	0.025 ^a	0.0032 ± 0.0001 ^b	0.028 ± 0.017	/	/
C8H7NO5	0.11 ^a	0.041 ± 0.022 ^b	0.015 ± 0.0047	0.0033 ^a	0.0083 ± 0.0043	/
C8H9NO5	0.094 ± 0.15	0.20 ± 0.14	0.12 ± 0.025	0.030 ± 0.022	0.030 ± 0.011	0.016 ± 0.017
C11H9NO3	0.065 ± 0.065	0.13 ± 0.075	0.061 ± 0.045	0.044 ± 0.044	0.064 ± 0.055	0.041 ± 0.031
C10H11NO4	0.0076 ^a	0.040 ^a	0.0015 ± 0.0006	0.0039 ± 0.0038	/	0.00088 ^a
C10H11NO5	/	/	/	0.016 ± 0.0064 ^b	/	0.0013 ^a
C11H13NO5	/	/	0.0011 ± 0.0002 ^b	0.0087 ± 0.0091	0.0022 ^a	0.0008 ± 0.0001 ^b
C11H13NO6	/	/	/		/	/
Subtotal	0.43 ± 0.45	0.61 ± 0.27	0.33 ± 0.093	0.24 ± 0.045	0.25 ± 0.17	0.16 ± 0.077
OC (µg m ⁻³)	48.2 ± 20.4	72.4 ± 41.9	186 ± 67.7	474 ± 21.8	143 ± 94.8	626 ± 313

^aThe compound was detected in only one of the three filter samples; ^bthe compound was detected in two of the three filter samples or only two out of the three filters were available for measurement, the values reported here are average ± difference between the two measurements/2.

Table S7. Continue

Compound	Prakti Leo		Zoom Jet	
	CS	HS	CS	HS
C6H5NO3	0.015 ± 0.0033	0.0041 ± 0.0016	0.0095 ± 0.0020	0.0020 ± 0.0014
C7H7NO3	0.0039 ± 0.0030	0.0008 ^a	0.0039 ± 0.0015	/
C6H5NO4	0.016 ± 0.0062 ^b	0.040 ± 0.017	0.034 ^a	0.038 ± 0.029
C7H7NO4	0.0014 ± 0.0005 ^b	0.038 ± 0.021	0.0037 ± 0.0021 ^b	0.037 ± 0.030
C8H7NO4	/	/	/	0.0028 ^a
C8H9NO4	0.0038 ± 0.0002 ^b	0.058 ± 0.034	0.015 ^a	0.040 ± 0.016
C8H5NO2	/	/	/	/
C7H7NO5	0.0031 ^a	0.0078 ± 0.0063	0.0062 ^a	0.0089 ± 0.0094
C10H7NO3	0.12 ± 0.093	0.019 ± 0.0066	0.072 ± 0.032	0.030 ± 0.021
C9H9NO4	0.012 ^a	0.0060 ^a	/	0.019 ^a
C8H7NO5	0.042 ± 0.0029 ^b	0.0008 ^a	0.044 ^a	/
C8H9NO5	0.26 ± 0.15	0.017 ± 0.0045	0.18 ± 0.26	0.060 ± 0.087
C11H9NO3	0.089 ± 0.083	0.030 ± 0.0038	0.040 ± 0.018	0.064 ± 0.058
C10H11NO4	0.0026 ± 0.0004 ^b	0.0014 ± 0.0010	/	0.0019 ± 0.0008
C10H11NO5	/	0.0019 ± 0.0007 ^b	/	0.0017 ± 0.0001 ^b
C11H13NO5	0.0011	0.0018 ± 0.0010 ^b	/	0.0042 ± 0.0020
C11H13NO6	/	/	/	/
Subtotal	0.54 ± 0.083	0.22 ± 0.058	0.34 ± 0.32	0.29 ± 0.24
OC ($\mu\text{g m}^{-3}$)	125 ± 63.4	504 ± 92.2	73.5 ± 13.4	558 ± 347

Table S8. Average mass ratios (%) of individual NACs to OC (iNACoc%) in Q_b samples for burning charcoal in different household cookstoves.

Compound	CH4400		Éclair		Jiko Koa	
	CS	HS	CS	HS	CS	HS
C6H5NO3	0.12 ± 0.010 ^b	0.056 ± 0.074	0.0083 ± 0.0049	0.0039 ^a	0.071 ^a	0.0006 ± 0.00002 ^b
C7H7NO3	0.020 ± 0.0058 ^b	0.0096 ± 0.0063	0.0035 ± 0.0011 ^b	0.0014 ^a	0.0046 ± 0.0026 ^b	/
C6H5NO4	/	0.32 ^a	0.054 ± 0.012 ^b	0.14 ± 0.015	0.086 ± 0.074 ^b	0.11 ± 0.066
C7H7NO4	0.029 ^a	0.064 ^a	0.0087 ± 0.0031	0.12 ± 0.051	0.11 ± 0.11 ^b	0.13 ± 0.12
C8H7NO4	/	/	/	0.051 ^a	/	/
C8H9NO4	0.0031 ± 0.0024 ^b	0.016 ^a	0.0091 ± 0.0032 ^b	0.18 ± 0.13	0.092 ± 0.091 ^b	0.11 ± 0.11
C8H5NO2	/	/	/	/	/	/
C7H7NO5	/	/	/	0.021 ± 0.011	0.030 ^a	0.0092 ^a
C10H7NO3	0.76 ± 0.023 ^b	0.43 ± 0.19	0.10 ± 0.084	0.036 ± 0.035	0.10 ± 0.021	0.0033 ± 0.040
C9H9NO4	0.041 ^a	0.037 ^a	0.0077 ± 0.0022 ^b	0.070 ± 0.061	/	0.053 ^a
C8H7NO5	0.17 ^a	0.087 ^a	0.023 ± 0.012 ^b	0.013 ± 0.0019	0.011 ^a	0.037 ^a
C8H9NO5	0.23 ± 0.11 ^b	0.39 ± 0.14	0.33 ± 0.11	0.20 ± 0.11	0.13 ± 0.074	0.046 ± 0.025
C11H9NO3	0.99 ± 0.36 ^b	0.37 ± 0.25	0.13 ± 0.086	0.18 ± 0.18	0.23 ± 0.17	0.11 ± 0.060
C10H11NO4	0.0067 ^a	0.0063 ^a	0.0030 ± 0.0010 ^b	0.019 ± 0.015	/	0.0099 ^a
C10H11NO5	/	/	0.0007 ^a	0.075 ± 0.071	/	0.0011 ^a
C11H13NO5	/	/	0.0033 ^a	0.041 ± 0.042	0.0063 ^a	0.0038 ^a
C11H13NO6	/	/	/	/	/	/
Subtotal	2.25 ± 0.17 ^b	1.44 ± 0.20	0.65 ± 0.23	1.12 ± 0.12	0.70 ± 0.51	0.58 ± 0.20
OC (µg m ⁻³)	19.2 ± 14.7 ^b	40.5 ± 15.3	59.0 ± 17.0	131 ± 7.68	57.8 ± 30.8	212 ± 69.7

^aThe compound was detected in only one of the three filter samples; ^b the compound was detected in two of the three filter samples or only two out of the three filters were available for measurement, the values reported here are average ± difference between the two measurements/2.

Table S8. Continue

	Prakti Leo		Zoom Jet	
	CS	HS	CS	HS
C6H5NO3	0.017 ± 0.017	0.0034 ^a	0.0065 ± 0.0046 ^b	/
C7H7NO3	0.0046 ± 0.0025	/	0.0096 ± 0.010	/
C6H5NO4	0.049 ± 0.032 ^b	0.17 ± 0.14	0.20 ^a	0.17 ± 0.11
C7H7NO4	0.0063 ± 0.0046 ^b	0.28 ± 0.29	0.011 ± 0.017	0.19 ± 0.12
C8H7NO4	/	/	/	/
C8H9NO4	0.011 ± 0.0062 ^b	0.31 ± 0.26	0.065 ^a	0.18 ± 0.070
C8H5NO2	/	/	/	/
C7H7NO5	0.0041 ^a	0.052 ± 0.062	/	0.036 ± 0.027
C10H7NO3	0.13 ± 0.095	0.026 ± 0.012	0.10 ± 0.12	0.041 ± 0.041
C9H9NO4	0.078 ^a	0.048 ± 0.0056 ^b	/	0.031 ± 0.013
C8H7NO5	0.072 ± 0.018 ^b	0.018 ^a	/	0.019 ± 0.0081 ^b
C8H9NO5	0.57 ± 0.37	0.13 ± 0.016	0.97 ± 1.51	0.21 ± 0.24
C11H9NO3	0.12 ± 0.072	0.12 ± 0.012	0.24 ± 0.14	0.18 ± 0.16
C10H11NO4	0.0051 ± 0.0007 ^b	0.0081 ± 0.037	0.0051 ^a	0.0078 ± 0.0023
C10H11NO5	/	0.021 ± 0.0014 ^b	/	0.023 ± 0.017
C11H13NO5	/	0.013 ± 0.013 ^b	/	0.025 ± 0.019
C11H13NO6	/	/	/	/
subtotal	0.96 ± 0.33	1.17 ± 0.75	1.34 ± 1.64	1.12 ± 0.76
OC ($\mu\text{g m}^{-3}$)	43.1 ± 10.4	149 ± 26.5	22.6 ± 7.59	157 ± 77.4

Table S9. Average contributions (%) of individual NACs to Abs₃₆₅ of Q_f extracts for burning red oak in different household cookstoves.

Compound	3-stone fire		EcoChula XXL		Envirofit G3300	
	CS	SIM	CS	HS	CS	HS
C6H5NO3	0.0040 ± 0.0007	0.024 ± 0.0005	0.090 ± 0.060	0.20 ± 0.12	0.0011 ± 0.0009 ^b	0.0015 ± 0.0012 ^b
C7H7NO3	0.0007 ^a	/	0.010 ± 0.0071	0.23 ± 0.014	0.0032 ^a	/
C6H5NO4	0.085 ± 0.023	0.13 ± 0.10	0.054 ± 0.0054	0.16 ± 0.12	0.059 ± 0.012	0.048 ± 0.011
C7H7NO4	0.071 ± 0.029	0.090 ± 0.070	0.011 ± 0.0052	0.032 ± 0.039	0.039 ± 0.0025	0.041 ± 0.028
C8H7NO4	/	/	/	/	/	/
C8H9NO4	0.046 ± 0.017	0.059 ± 0.018	0.0037 ± 0.0010	0.014 ± 0.0098	0.017 ± 0.0075	0.015 ± 0.022
C8H5NO2	/	/	/	/	/	/
C7H7NO5	0.0059 ± 0.0026	0.023 ± 0.019	/	/	/	/
C10H7NO3	0.12 ± 0.030	0.051 ± 0.027	0.90 ± 0.54	1.92 ± 1.16	0.19 ± 0.076	0.11 ± 0.049
C9H9NO4	0.060 ± 0.022	0.043 ± 0.016	0.016 ± 0.0023 ^b	0.021 ± 0.014 ^b	0.070 ± 0.018	0.026 ± 0.013
C8H7NO5	0.020 ^a		0.037 ± 0.022	0.090 ± 0.075	0.25 ± 0.093	0.069 ± 0.044
C8H9NO5	0.040 ± 0.023	0.061 ± 0.029	0.10 ± 0.045	0.31 ± 0.29	0.056 ± 0.032	0.021 ± 0.072
C11H9NO3	0.12 ± 0.064	0.037	0.18 ± 0.12	0.36 ± 0.22	0.073 ± 0.023	0.055 ± 0.021
C10H11NO4	/	/	/	/	/	/
C10H11NO5	0.13 ± 0.038	0.16 ± 0.090	/	0.068 ^a	/	/
C11H13NO5	/	/	/	/	/	/
C11H13NO6	/	/	/	/	/	/
Subtotal	0.69 ± 0.25	0.63 ± 0.28	1.39 ± 0.78	3.14 ± 1.91	0.76 ± 0.21	0.39 ± 0.15

^aThe compound was detected in only one of the three filter samples; ^b the compound was detected in two of the three filter samples or only two out of the three filters were available for measurement, the values reported here are average ± difference between the two measurements/2.

Table S9. Continue

Compound	Home Stove		Jiko Poa		Jiko Poa (HM)	
	CS	HS	CS	HS	CS	HS
C6H5NO3	0.0017 ± 0.0000 ^b	0.0036 ± 0.0015 ^b	0.0015 ± 0.0011	0.0024 ^a	0.0011 ± 0.0004 ^b	0.0014 ± 0.0004 ^b
C7H7NO3	0.0011 ^a	0.0012 ± 0.0007 ^b	0.0004 ± 0.0001	0.0004 ± 0.0001 ^b	0.0003 ± 0.0000 ^b	/
C6H5NO4	0.068 ± 0.021	0.11 ± 0.056	0.051 ± 0.0030	0.070 ± 0.0014 ^b	0.079 ± 0.025	0.076 ± 0.035
C7H7NO4	0.084 ± 0.056	0.045 ± 0.028	0.034 ± 0.0027	0.048 ± 0.0010 ^b	0.048 ± 0.014	0.050 ± 0.015
C8H7NO4	/	/	/	/	/	/
C8H9NO4	0.062 ± 0.043	0.0099 ± 0.0073	0.030 ± 0.0006	0.031 ± 0.0083 ^b	0.036 ± 0.015	0.032 ± 0.0050
C8H5NO2	/	0.0001 ^a	0.0026 ± 0.0018	0.0051 ± 0.0022 ^b	0.0001 ± 0.0000	0.0003 ± 0.0001
C7H7NO5	0.027 ± 0.0018 ^b	0.0093 ^a	0.024 ± 0.0057	0.012 ± 0.0013 ^b	0.033 ± 0.010	0.026 ± 0.012
C10H7NO3	0.10 ± 0.047	0.15 ± 0.079	0.087 ± 0.012	0.13 ± 0.0040 ^b	0.073 ± 0.0057	0.083 ± 0.029
C9H9NO4	0.16 ± 0.0000 ^b	/	0.11 ± 0.016	0.12 ± 0.031 ^b	0.12 ± 0.057	0.066 ± 0.031
C8H7NO5	0.27 ± 0.13	0.51 ± 0.13	0.083 ± 0.052	0.14 ± 0.0025 ^b	0.016 ^a	0.018 ± 0.013
C8H9NO5	0.31 ± 0.13	0.46 ± 0.41	0.061 ± 0.014	0.11 ± 0.021 ^b	0.052 ± 0.0063	0.073 ± 0.027
C11H9NO3	0.071 ± 0.043	0.069 ± 0.027	0.054 ± 0.0040	0.076 ± 0.018 ^b	0.038 ± 0.0041	0.052 ± 0.014
C10H11NO4	/	/	/	/	/	/
C10H11NO5	0.29 ± 0.19	0.20 ± 0.083	0.16 ± 0.016	0.21 ± 0.10 ^b	0.40 ± 0.19	0.34 ± 0.22
C11H13NO5	/	/	/	/	/	/
C11H13NO6	/	/	/	/	/	/
subtotal	1.38 ± 0.48	1.54 ± 0.56	0.70 ± 0.092	0.95 ± 0.027	0.88 ± 0.27	0.82 ± 0.27

Table S10. Average contributions (%) of individual NACs to Abs₃₆₅ of Q_b extracts for burning red oak in different household cookstoves.

Compound	3-stone fire		EcoChula XXL		Envirofit G3300	
	CS	HS	CS	HS	CS	HS
C6H5NO3	0.0076 ^a	0.0060 ± 0.0060	0.69 ± 0.20	0.63 ± 0.25	0.0079 ± 0.0062 ^b	0.011 ^a
C7H7NO3	/	/	0.089 ± 0.030	0.081 ± 0.018	0.051 ^a	/
C6H5NO4	0.64 ± 0.029	0.97 ± 0.83	0.85 ± 0.32	2.05 ± 1.83	0.35 ± 0.074	0.46 ± 0.024
C7H7NO4	0.72 ± 0.24	0.89 ± 0.67	0.14 ± 0.060	0.24 ± 0.28	0.67 ± 0.11	1.05 ± 0.48
C8H7NO4	/	/	/	/	/	/
C8H9NO4	0.41 ± 0.036	0.63 ± 0.14	0.062 ± 0.025	0.078 ± 0.084	0.33 ± 0.13	0.64 ± 0.47
C8H5NO2	/	/	/	/	/	/
C7H7NO5	0.16 ± 0.026	0.31 ± 0.29	/	/	/	/
C10H7NO3	0.50 ± 0.21	0.18 ± 0.23	9.55 ± 1.73	5.65 ± 3.70	0.45 ± 0.22	0.29 ± 0.31
C9H9NO4	0.40 ± 0.18	0.30 ± 0.11	/	0.032 ^a	0.86 ± 0.12	0.57 ± 0.17
C8H7NO5	0.16 ± 0.036	0.16 ± 0.020	0.66 ± 0.070	0.58 ± 0.29	2.28 ± 0.57	0.47 ± 0.28
C8H9NO5	0.53 ± 0.24	0.67 ± 0.33	1.63 ± 0.20	1.73 ± 1.67	0.45 ± 0.31	0.21 ± 0.036
C11H9NO3	1.01 ± 0.44	0.24 ± 0.22	1.57 ± 1.13	1.74 ± 0.60	0.54 ± 0.18	0.42 ± 0.21
C10H11NO4	/	/	/	/	/	/
C10H11NO5	1.91 ± 0.78	3.90 ± 3.01	/	/	/	/
C11H13NO5	/	/	/	/	/	/
C11H13NO6	/	/	/	/	/	/
subtotal	6.44 ± 1.96	8.27 ± 2.86	15.2 ± 0.75	12.8 ± 6.46	5.95 ± 0.62	4.10 ± 0.33

^aThe compound was detected in only one of the three filter samples; ^bthe compound was detected in two of the three filter samples or only two out of the three filters were available for measurement, the values reported here are average ± difference between the two measurements/2.

Table S10. Continue

Compound	Home Stove		Jiko Poa		Jiko Poa (HM)	
	CS	HS	CS	HS	CS	HS
C6H5NO3	0.016 ± 0.014 ^b	0.0061 ± 0.0019 ^b	0.0075 ± 0.0033	0.0079 ^a	0.0009 ^a	0.0037 ± 0.0017 ^b
C7H7NO3	/	/	0.0019 ± 0.0003	0.0018 ± 0.0011 ^b	/	/
C6H5NO4	0.61 ± 0.32	0.95 ± 0.59	0.33 ± 0.078	0.41 ± 0.24 ^b	0.69 ± 0.21	1.03 ± 0.38
C7H7NO4	0.57 ± 0.39	0.33 ± 0.17	0.42 ± 0.061	0.45 ± 0.28 ^b	0.66 ± 0.18	0.86 ± 0.16
C8H7NO4	/	/	/	/	/	/
C8H9NO4	0.43 ± 0.34	0.050 ± 0.019	0.40 ± 0.032	0.37 ± 0.19 ^b	0.52 ± 0.29	0.52 ± 0.24
C8H5NO2	/	/	0.0005 ± 0.0001 ^b	0.0031 ± 0.0014 ^b	0.0002 ^a	/
C7H7NO5	0.16 ± 0.017 ^b	0.048 ^a	0.065 ± 0.0050	0.056 ± 0.020 ^b	0.25 ± 0.034	0.37 ± 0.13
C10H7NO3	0.96 ± 0.81	0.92 ± 1.00	0.17 ± 0.0043	0.21 ± 0.090 ^b	0.15 ± 0.0042	0.32 ± 0.035
C9H9NO4	1.21 ± 0.015 ^b	/	0.79 ± 0.24	0.89 ± 0.40 ^b	0.81 ± 0.33	0.37 ± 0.19
C8H7NO5	3.81 ± 1.65	4.53 ± 2.00	0.45 ± 0.15	0.73 ± 0.062 ^b	0.24 ± 0.20	0.33 ± 0.18
C8H9NO5	4.22 ± 2.20	4.24 ± 1.52	0.33 ± 0.020	0.57 ± 0.28 ^b	0.76 ± 0.41	0.90 ± 0.20
C11H9NO3	0.81 ± 0.57	0.53 ± 0.36 ^b	0.46 ± 0.027	0.55 ± 0.26 ^b	0.34 ± 0.0043	0.54 ± 0.053
C10H11NO4	/	/	/	/	/	/
C10H11NO5	2.72 ± 1.78	1.94 ± 0.88	1.49 ± 0.35	1.72 ± 0.79 ^b	4.97 ± 1.53	4.35 ± 2.08
C11H13NO5	/	/	/	/	/	/
C11H13NO6	/	/	/	/	/	/
subtotal	15.0 ± 6.21	13.3 ± 5.28	4.91 ± 0.85	5.97 ± 1.04	9.38 ± 1.10	9.59 ± 2.35

^aThe compound was detected in only one of the three filter samples; ^bthe compound was detected in two of the three filter samples or only two out of the three filters were available for measurement, the values reported here are average ± difference between the two measurements/2.

Table S11. Average contributions (%) of individual NACs to Abs₃₆₅ of Q_f extracts for burning charcoal in different household cookstoves.

Compound	CH4400		Éclair		Jiko Koa	
	CS	HS	CS	HS	CS	HS
C6H5NO3	0.081 ± 0.11	0.087 ± 0.067 ^b	0.032 ± 0.020	0.0054 ± 0.0034	0.0088 ± 0.0075	0.0037 ± 0.0002 ^b
C7H7NO3	0.017 ± 0.022	0.014 ± 0.0088	0.011 ± 0.0082	0.0022 ^a	0.0093 ± 0.0051 ^b	0.0015 ^a
C6H5NO4	/	0.092 ^a	0.13 ± 0.014 ^b	0.19 ± 0.0013	0.17 ^a	0.13 ± 0.082
C7H7NO4	0.019 ^a	0.013 ^a	0.039 ± 0.0036 ^b	0.21 ± 0.050	0.18 ± 0.15 ^b	0.19 ± 0.19
C8H7NO4	/	/	/	/	/	/
C8H9NO4	0.0091 ± 0.0009 ^b	0.020 ± 0.016 ^b	0.053 ± 0.0070 ^b	0.25 ± 0.096	0.16 ± 0.13 ^b	0.19 ± 0.20
C8H5NO2	/	/	0.0082 ± 0.0090	0.0009 ± 0.0006	/	/
C7H7NO5	/	/	0.0083 ^a	0.054 ± 0.033	0.051 ^a	0.037 ± 0.025 ^b
C10H7NO3	0.43 ± 0.57	0.37 ± 0.16	0.31 ± 0.073	0.038 ± 0.023	0.15 ± 0.15	0.035 ± 0.024
C9H9NO4	/	/	/	/	/	/
C8H7NO5	1.25 ^a	0.35 ± 0.22 ^b	0.25 ± 0.13	0.026 ^a	0.070 ± 0.064	/
C8H9NO5	1.14 ± 1.90	1.73 ± 1.63	2.05 ± 0.73	0.27 ± 0.17	0.30 ± 0.16	0.11 ± 0.10
C11H9NO3	0.18 ± 0.26	0.25 ± 0.13	0.24 ± 0.082	0.10 ± 0.095	0.12 ± 0.079	0.079 ± 0.046
C10H11NO4	/	/	/	/	/	/
C10H11NO5	/	/	/	0.16 ± 0.055	/	0.010 ^a
C11H13NO5	/	/	/	/	/	/
C11H13NO6	/	/	/	/	/	/
subtotal	2.27 ± 3.59	2.71 ± 2.20	3.04 ± 0.72	1.24 ± 0.065	0.95 ± 0.51	0.7675

^aThe compound was detected in only one of the three filter samples; ^bthe compound was detected in two of the three filter samples or only two out of the three filters were available for measurement, the values reported here are average ± difference between the two measurements/2.

Table S11. Continue

Compound	Prakti Leo		Zoom Jet	
	CS	HS	CS	HS
C6H5NO3	0.015 ± 0.0098	0.0074 ± 0.0041	0.010 ± 0.0044	0.0028 ± 0.0015
C7H7NO3	0.0039 ± 0.0010 ^b	0.0027 ± 0.0011 ^b	0.0059 ± 0.0035	/
C6H5NO4	0.21 ± 0.14 ^b	0.12 ± 0.11	0.069 ^a	0.15 ± 0.094
C7H7NO4	0.46 ± 0.45 ^b	0.17 ± 0.20	0.016 ± 0.0053 ^b	0.27 ± 0.18
C8H7NO4	/	/	/	/
C8H9NO4	0.88 ± 0.85 ^b	0.22 ± 0.25	0.055 ^a	0.30 ± 0.068
C8H5NO2	/	/	/	/
C7H7NO5	0.082 ± 0.062 ^b	0.065 ± 0.045 ^b	0.025 ^a	0.067 ± 0.065
C10H7NO3	0.12 ± 0.034	0.078 ± 0.053	0.12 ± 0.071	0.063 ± 0.034
C9H9NO4	/	/	/	/
C8H7NO5	0.21 ± 0.18	/	0.16 ^a	/
C8H9NO5	1.86 ± 1.27	0.17 ± 0.056	0.76 ± 1.01	0.45 ± 0.62
C11H9NO3	0.11 ± 0.058	0.082 ± 0.029	0.065 ± 0.039	0.13 ± 0.10
C10H11NO4	/	/	/	/
C10H11NO5	0.059 ^a	0.0090 ^a	/	0.016 ± 0.0020 ^b
C11H13NO5	/	/	/	/
C11H13NO6	/	/	/	/
subtotal	3.43 ± 0.42	0.89 ± 0.49	1.08 ± 1.14	1.44 ± 1.13

Table S12. Average contributions (%) of individual NACs to Abs₃₆₅ of Q_b extracts for burning charcoal in different household cookstoves.

Compound	CH4400		Éclair		Jiko Koa	
	CS	HS	CS	HS	CS	HS
C6H5NO3	0.37 ± 0.35 ^b	0.31 ± 0.35	0.076 ± 0.091	0.012 ^a	/	0.0018 ± 0.0007 ^b
C7H7NO3	0.066 ± 0.043 ^b	0.081 ± 0.063	0.043 ± 0.034 ^b	0.0057 ^a	0.014 ^a	/
C6H5NO4	/	1.76 ^a	0.65 ± 0.071 ^b	1.21 ± 0.25	0.66 ± 0.48 ^b	1.17 ± 0.90
C7H7NO4	0.19 ^a	0.64 ^a	0.18 ± 0.0070 ^b	1.89 ± 0.74	1.50 ± 1.47 ^b	2.81 ± 2.86
C8H7NO4	/	/	/	/	/	/
C8H9NO4	0.024 ± 0.012 ^b	0.16 ^a	0.19 ± 0.0046 ^b	2.86 ± 2.26	1.21 ± 1.19 ^b	2.51 ± 2.70
C8H5NO2	/	/	/	/	/	/
C7H7NO5	/	/	/	0.36 ± 0.17	0.42 ^a	0.19 ^a
C10H7NO3	2.57 ± 1.07 ^b	4.92 ± 5.69	0.79 ± 0.12	0.16 ± 0.17	0.66 ± 0.34 ^b	0.11 ± 0.084
C9H9NO4	/	/	/	/	/	/
C8H7NO5	2.94 ^a	2.29 ^a	0.64 ± 0.47 ^b	0.20 ± 0.050	0.15 ^a	0.72 ^a
C8H9NO5	3.61 ± 2.71 ^b	13.9 ± 10.3	13.4 ± 7.65	3.28 ± 1.93	2.01 ± 0.67 ^b	0.74 ± 0.031
C11H9NO3	2.69 ± 0.077 ^b	2.69 ± 1.74	1.15 ± 0.31	0.84 ± 0.87	1.73 ± 0.22 ^b	0.48 ± 0.16
C10H11NO4	/	/	/	/	/	/
C10H11NO5	/	/	/	1.29 ± 1.31	/	0.023 ^a
C11H13NO5	/	/	/	/	/	/
C11H13NO6	/	/	/	/	/	/
Subtotal	10.9 ± 5.46	23.6 ± 15.7	16.5 ± 7.50	12.1 ± 1.95	8.07 ± 3.53	8.12 ± 6.41

^aThe compound was detected in only one of the three filter samples; ^bthe compound was detected in two of the three filter samples or only two out of the three filters were available for measurement, the values reported here are average ± difference between the two measurements/2.

Table S12. Continue

Compound	Prakti Leo		Zoom Jet	
	CS	HS	CS	HS
C6H5NO3	0.070 ± 0.046 ^b	0.0088 ± 0.0016 ^b	0.012 ± 0.0007 ^b	/
C7H7NO3	0.015 ± 0.0077 ^b	0.0090 ^a	0.063 ± 0.065	/
C6H5NO4	3.20 ± 2.48 ^b	1.20 ± 1.61	0.65 ^a	3.32 ± 3.89
C7H7NO4	8.12 ± 7.94 ^b	3.65 ± 5.60	0.19	6.72 ± 7.80
C8H7NO4	/	/	/	/
C8H9NO4	11.7 ± 11.4 ^b	3.68 ± 5.41	0.39 ^a	5.07 ± 3.52
C8H5NO2	/	/	/	/
C7H7NO5	1.16 ± 1.08 ^b	1.18 ± 1.05 ^b	/	1.41 ± 1.77
C10H7NO3	0.50 ± 0.27	0.20 ± 0.16	0.93 ± 0.75	0.47 ± 0.65
C9H9NO4	/	/	/	/
C8H7NO5	1.32 ± 0.37	/	/	0.74 ± 0.53 ^b
C8H9NO5	13.2 ± 2.83	1.86 ± 0.72	7.73 ± 8.55	9.29 ± 13.6
C11H9NO3	1.33 ± 1.68	0.47 ± 0.13	1.18 ± 1.00 ^b	1.99 ± 2.63
C10H11NO4	/	/	/	/
C10H11NO5	2.07 ^a	0.36 ^a	/	0.89 ± 1.06
C11H13NO5	/	/	/	/
C11H13NO6	/	/	/	/
Subtotal	33.2 ± 29.1	12.0 ± 14.2	10.1 ± 8.02	29.7 ± 35.4

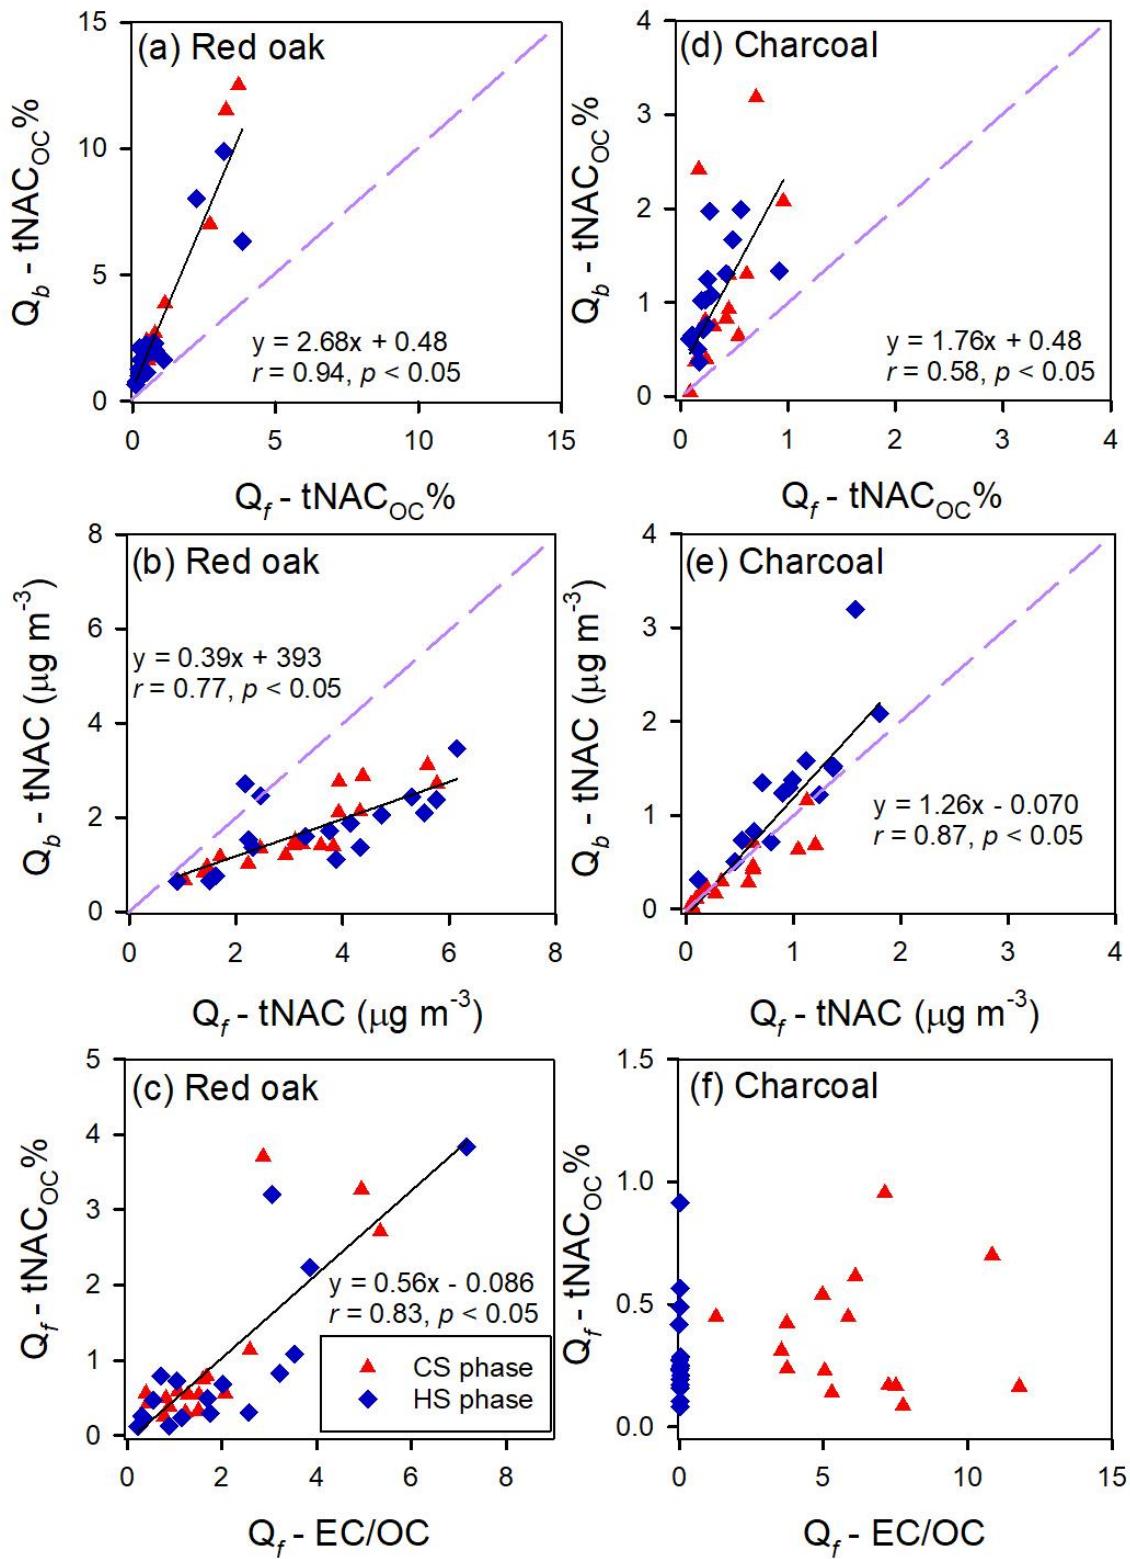


Figure S1. Linear regressions of (a, d) tNAC_{OC}% in Q_f vs. Q_b samples, (b, e) total NAC concentrations in Q_f vs. Q_b samples, (c, f) tNAC_{OC}% vs. EC/OC for Q_f samples for red oak and charcoal burning, respectively.

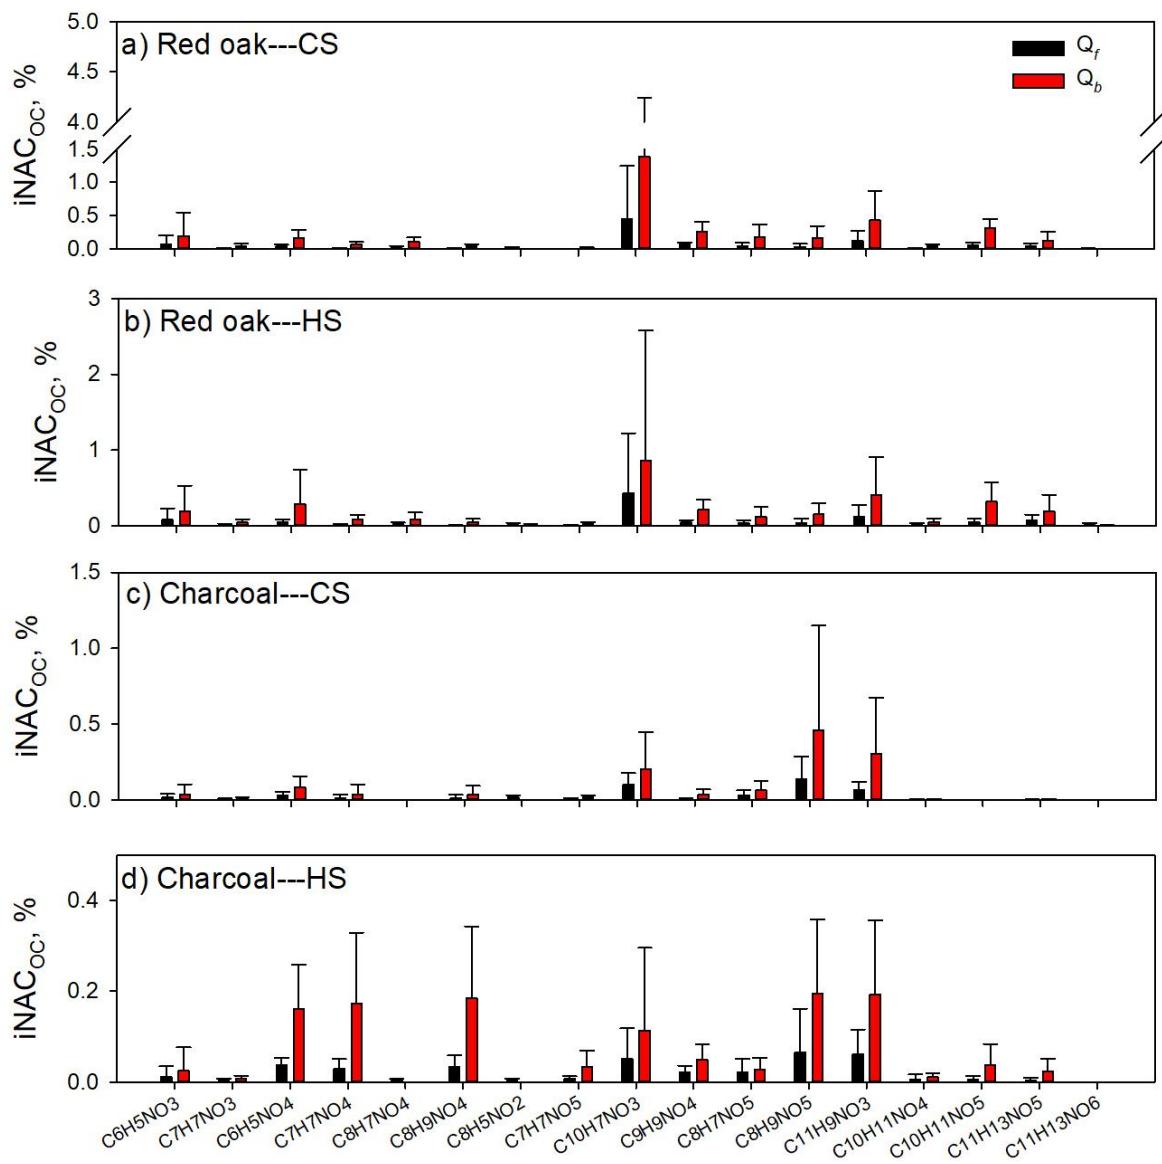


Figure S2. Average mass ratios of individual NACs to OC × 100% (iNACOC%) for (a) red oak burning under the CS phase, (b) red oak burning under the HS phase, (c) charcoal burning under the CS phase, and (d) charcoal burning under the HS phase.

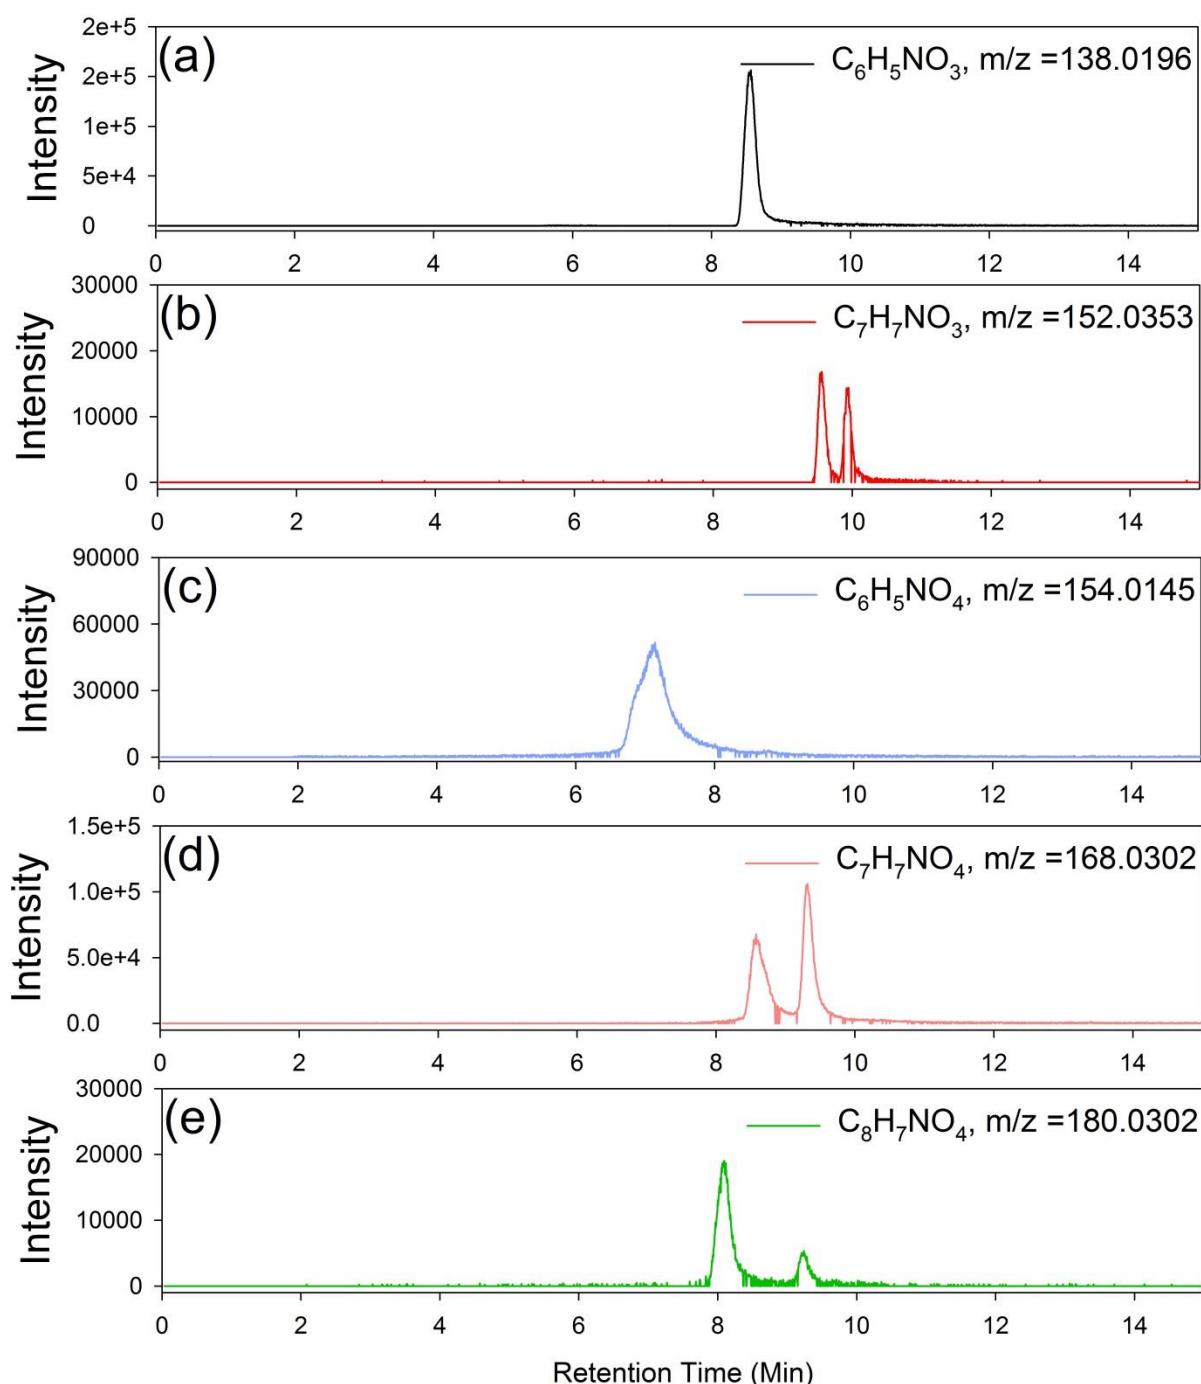


Figure S3. Extracted ion chromatograms (EIC) of (a) $\text{C}_6\text{H}_5\text{NO}_3$, (b) $\text{C}_7\text{H}_7\text{NO}_3$, (c) $\text{C}_6\text{H}_5\text{NO}_4$, (d) $\text{C}_7\text{H}_7\text{NO}_4$, (e) $\text{C}_8\text{H}_7\text{NO}_4$, (f) $\text{C}_8\text{H}_9\text{NO}_4$, (g) $\text{C}_8\text{H}_5\text{NO}_2$, (h) $\text{C}_7\text{H}_7\text{NO}_5$, (i) $\text{C}_{10}\text{H}_7\text{NO}_3$, (j) $\text{C}_9\text{H}_9\text{NO}_4$, (k) $\text{C}_8\text{H}_7\text{NO}_5$, (l) $\text{C}_8\text{H}_9\text{NO}_5$, (m) $\text{C}_{11}\text{H}_9\text{NO}_3$, (n) $\text{C}_{10}\text{H}_{11}\text{NO}_4$, (o) $\text{C}_{10}\text{H}_{11}\text{NO}_5$, (p) $\text{C}_{11}\text{H}_{13}\text{NO}_5$ and (q) $\text{C}_{11}\text{H}_{13}\text{NO}_6$ identified in emissions from solid fuel-cookstove combustions (Table S3).

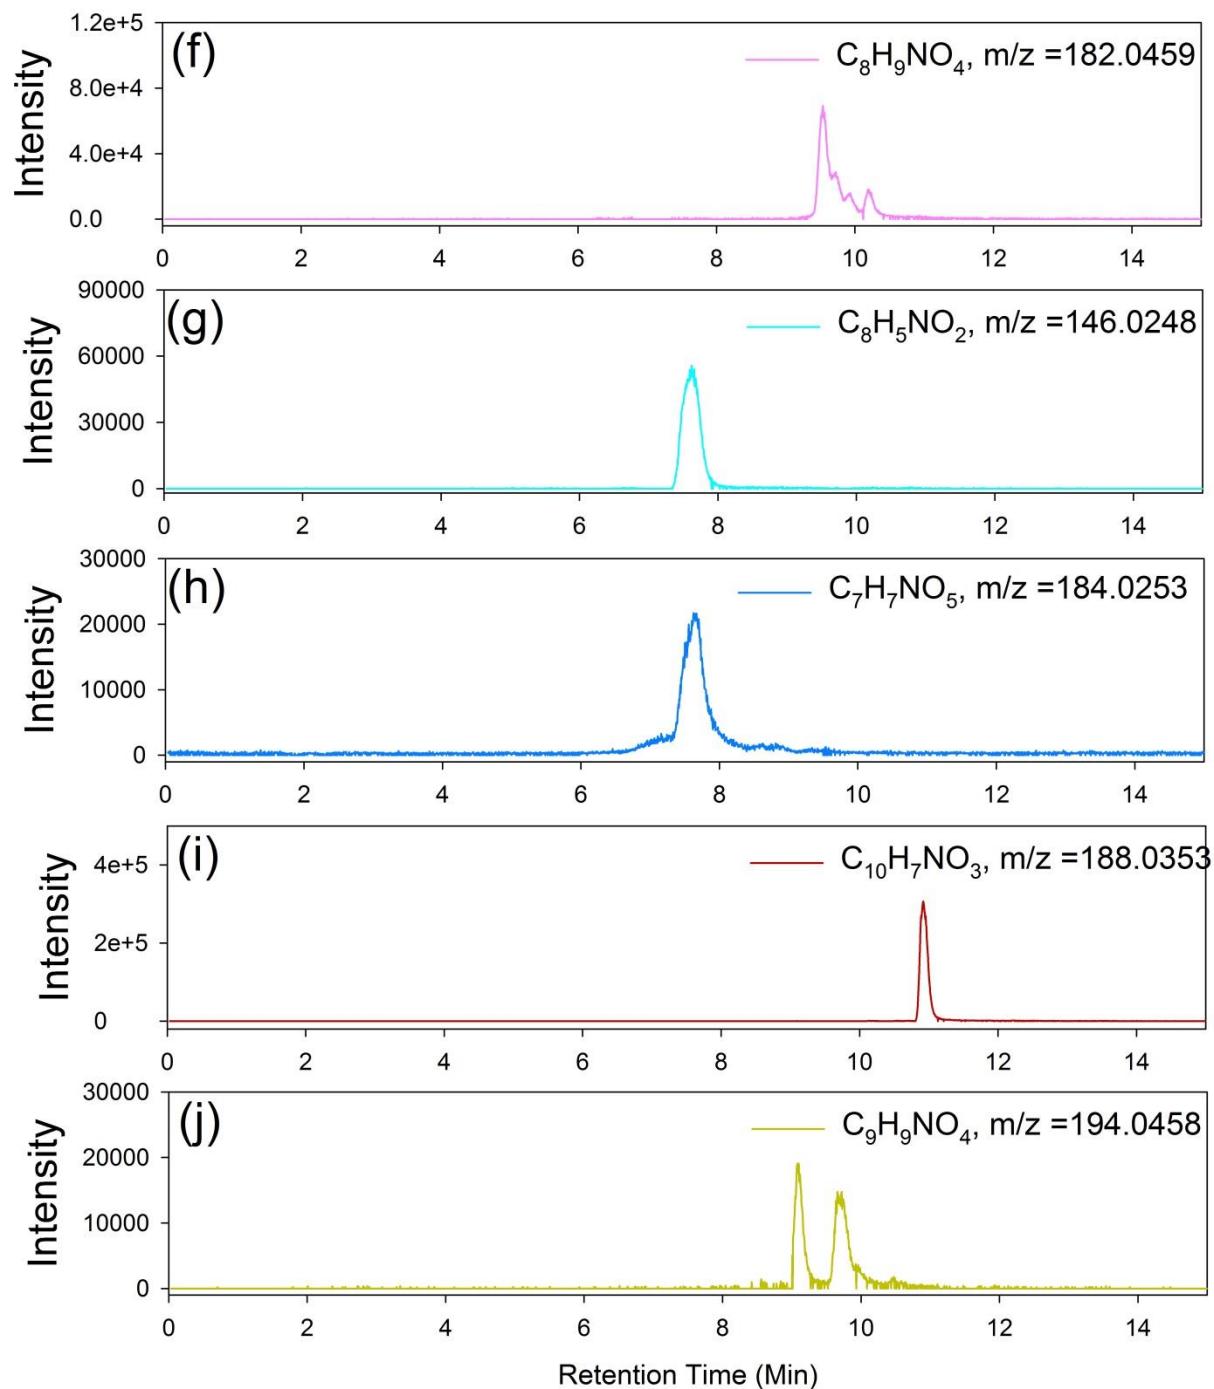


Figure S3. Continued.

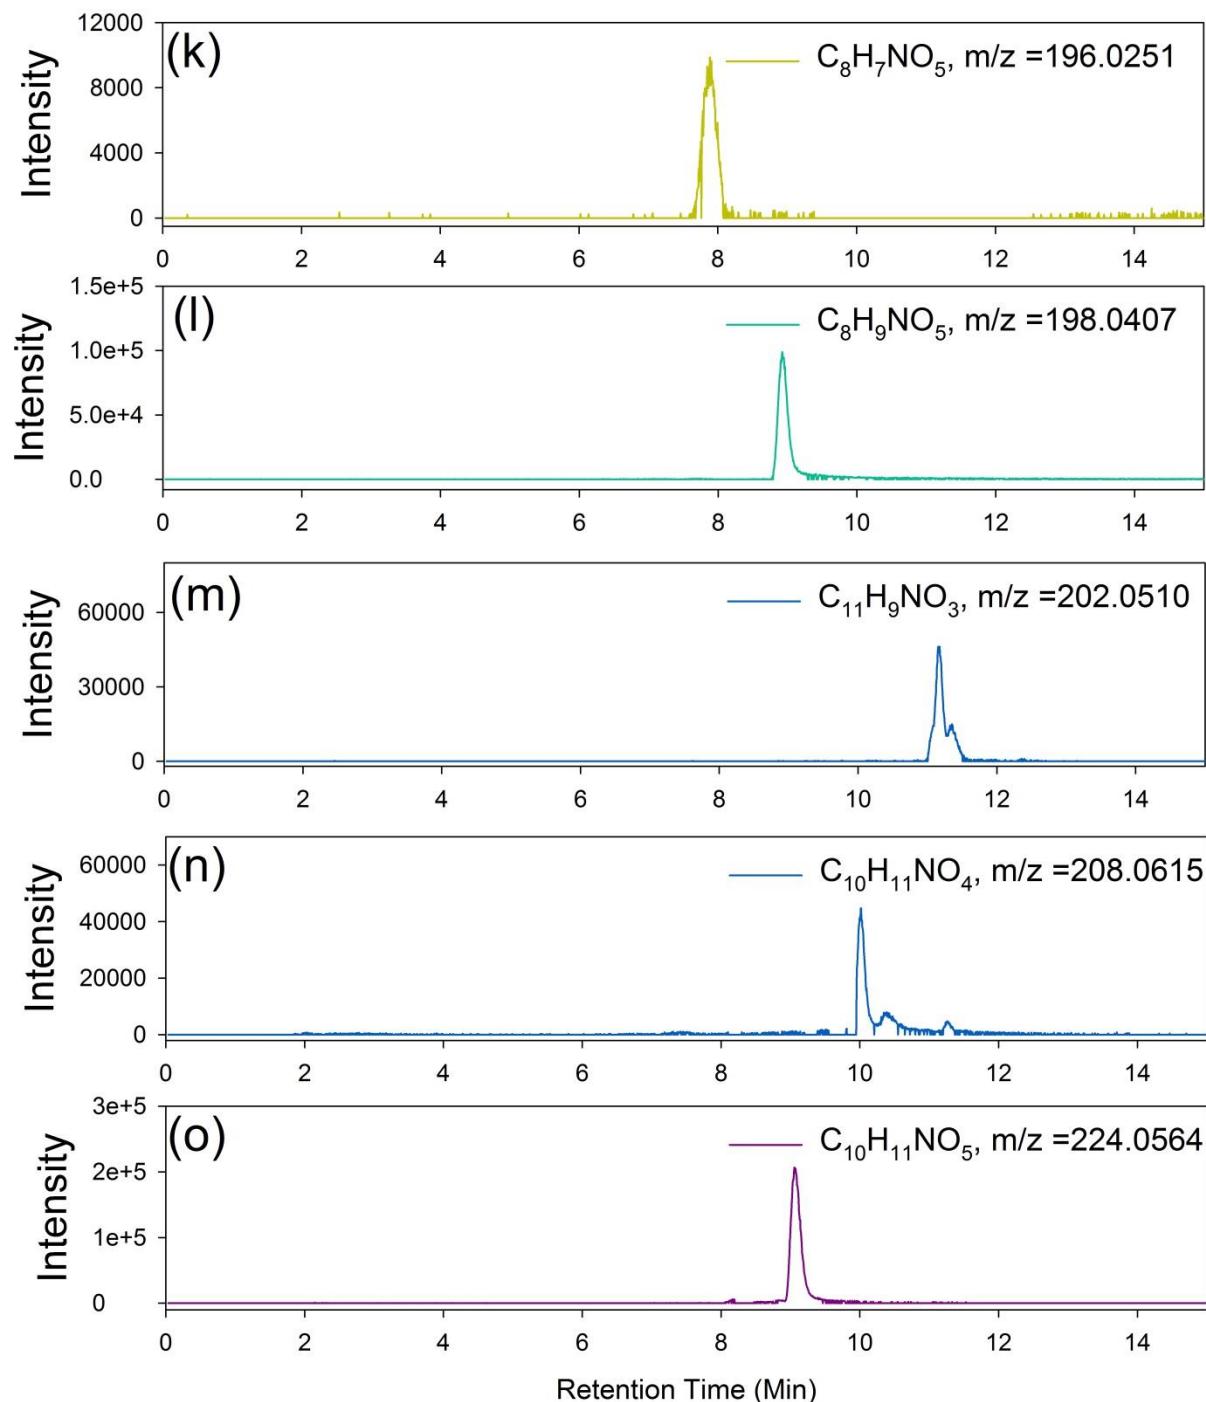


Figure S3. Continued.

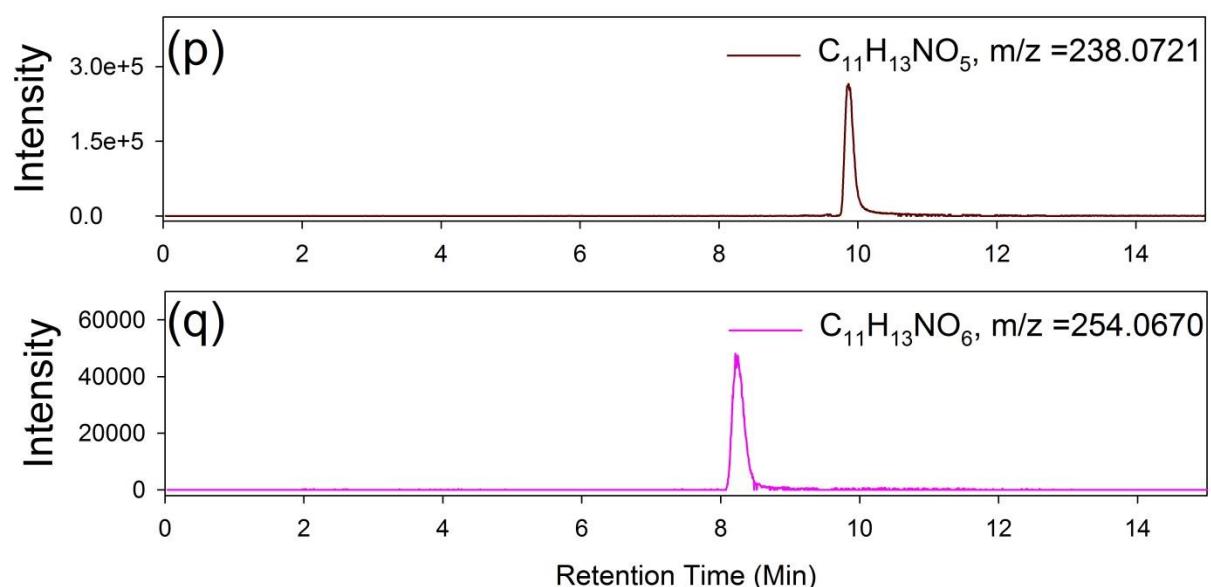


Figure S3. Continued.

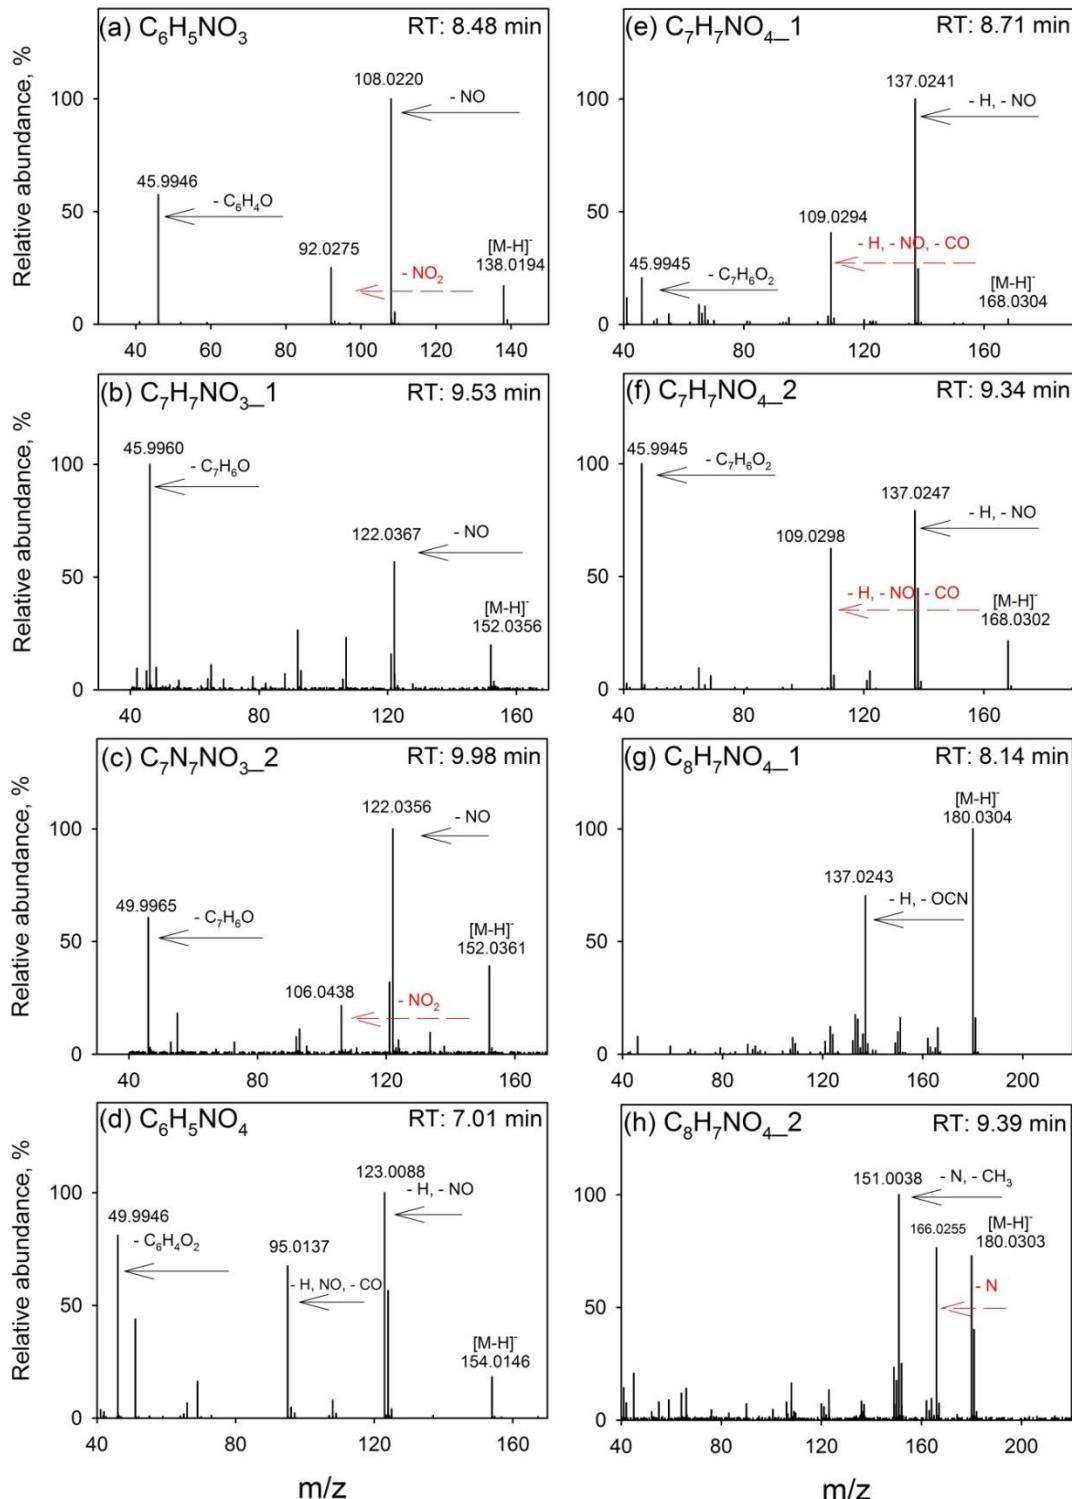


Figure S4. MS/MS spectra of (a) $\text{C}_6\text{H}_5\text{NO}_3$, (b, c) $\text{C}_7\text{H}_7\text{NO}_3$ isomers, (d) $\text{C}_6\text{H}_5\text{NO}_4$, (e, f) $\text{C}_7\text{H}_7\text{NO}_4$ isomers, (g, h) $\text{C}_8\text{H}_7\text{NO}_4$ isomers, (i) $\text{C}_8\text{H}_9\text{NO}_4$, (j) $\text{C}_8\text{H}_5\text{NO}_2$, (k) $\text{C}_7\text{H}_7\text{NO}_5$, (l) $\text{C}_{10}\text{H}_7\text{NO}_3$, (m, n) $\text{C}_9\text{H}_9\text{NO}_4$ isomers, (o) $\text{C}_8\text{H}_7\text{NO}_5$, (p) $\text{C}_8\text{H}_9\text{NO}_5$, (q) $\text{C}_{11}\text{H}_9\text{NO}_3$, (r) $\text{C}_{10}\text{H}_{11}\text{NO}_4$, (s) $\text{C}_{10}\text{H}_{11}\text{NO}_5$, (t) $\text{C}_{11}\text{H}_{13}\text{NO}_5$ and (u) $\text{C}_{11}\text{H}_{13}\text{NO}_6$ identified in emissions from solid fuel-cookstove combustions (Table S3).

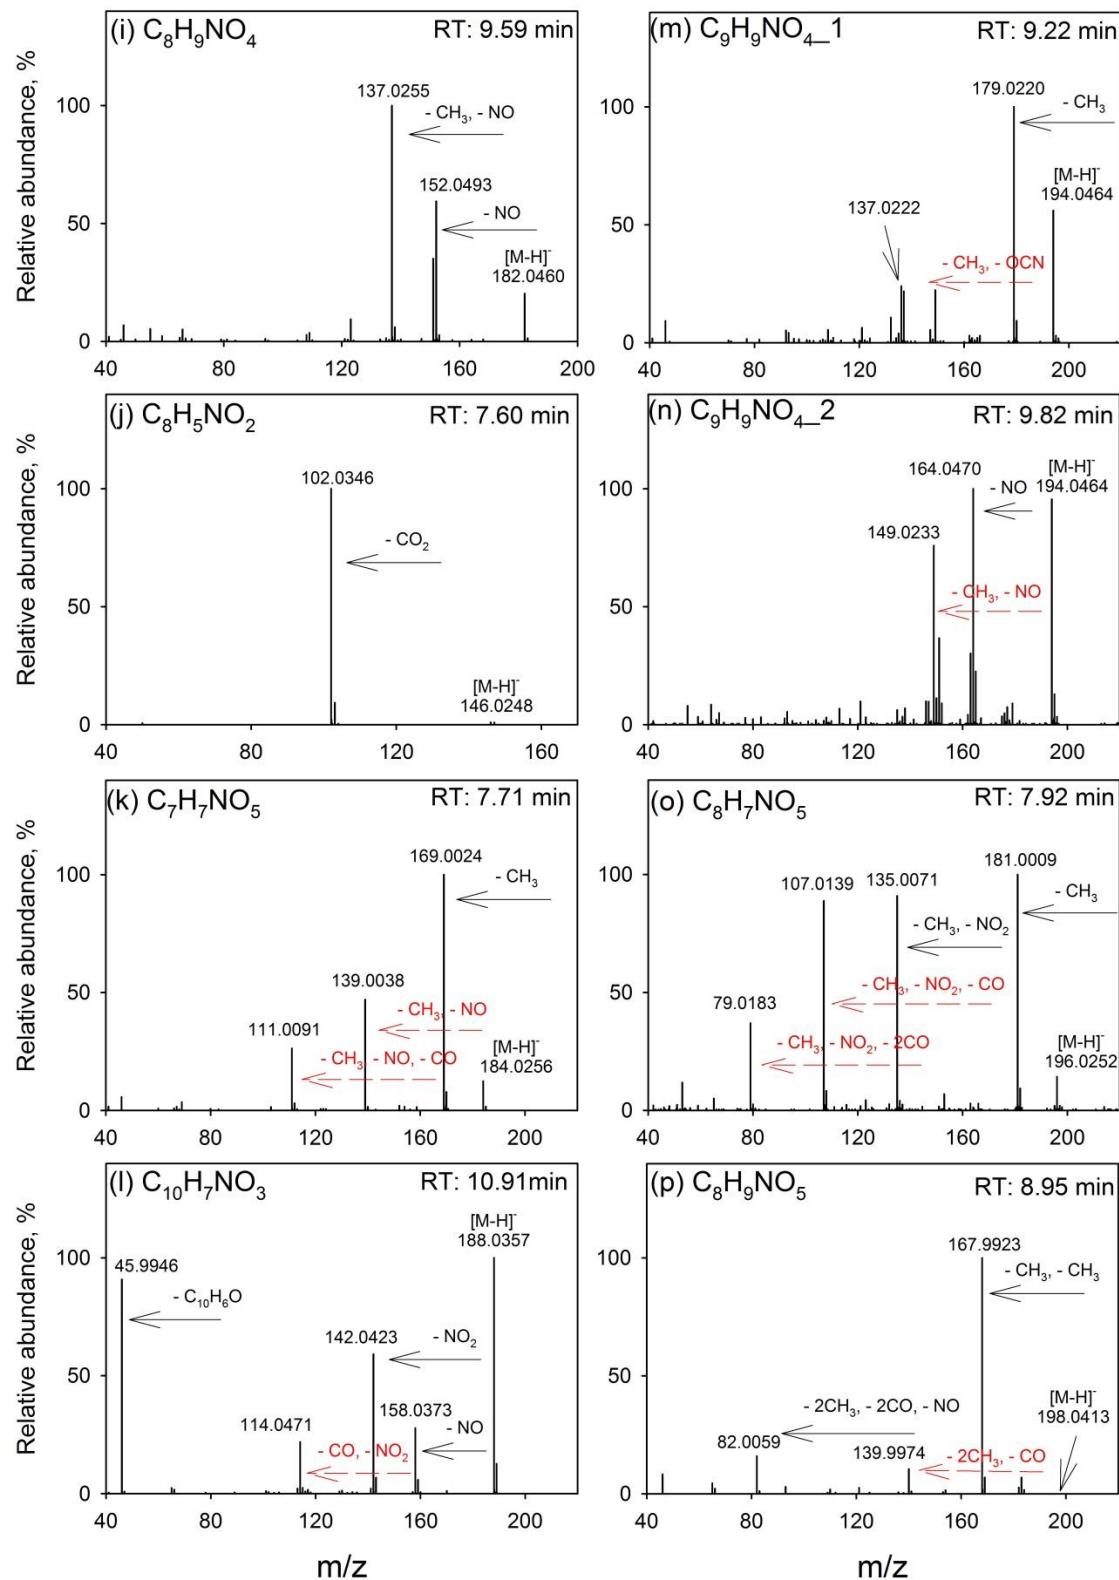


Figure S4. Continued

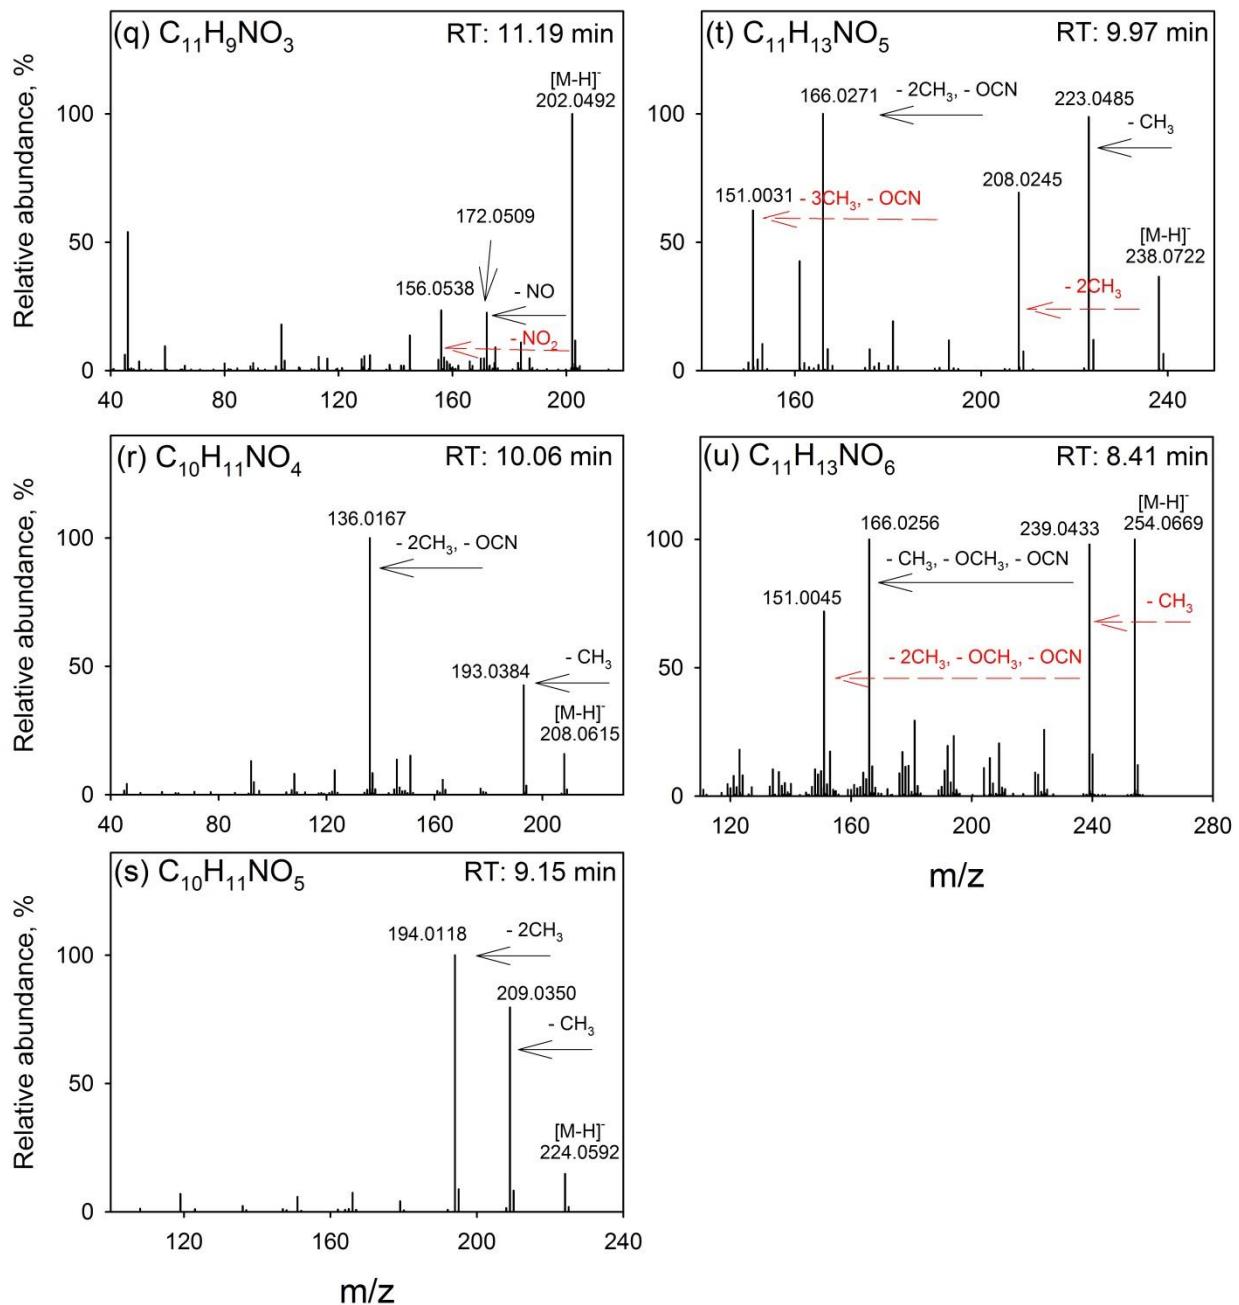


Figure S4. Continued

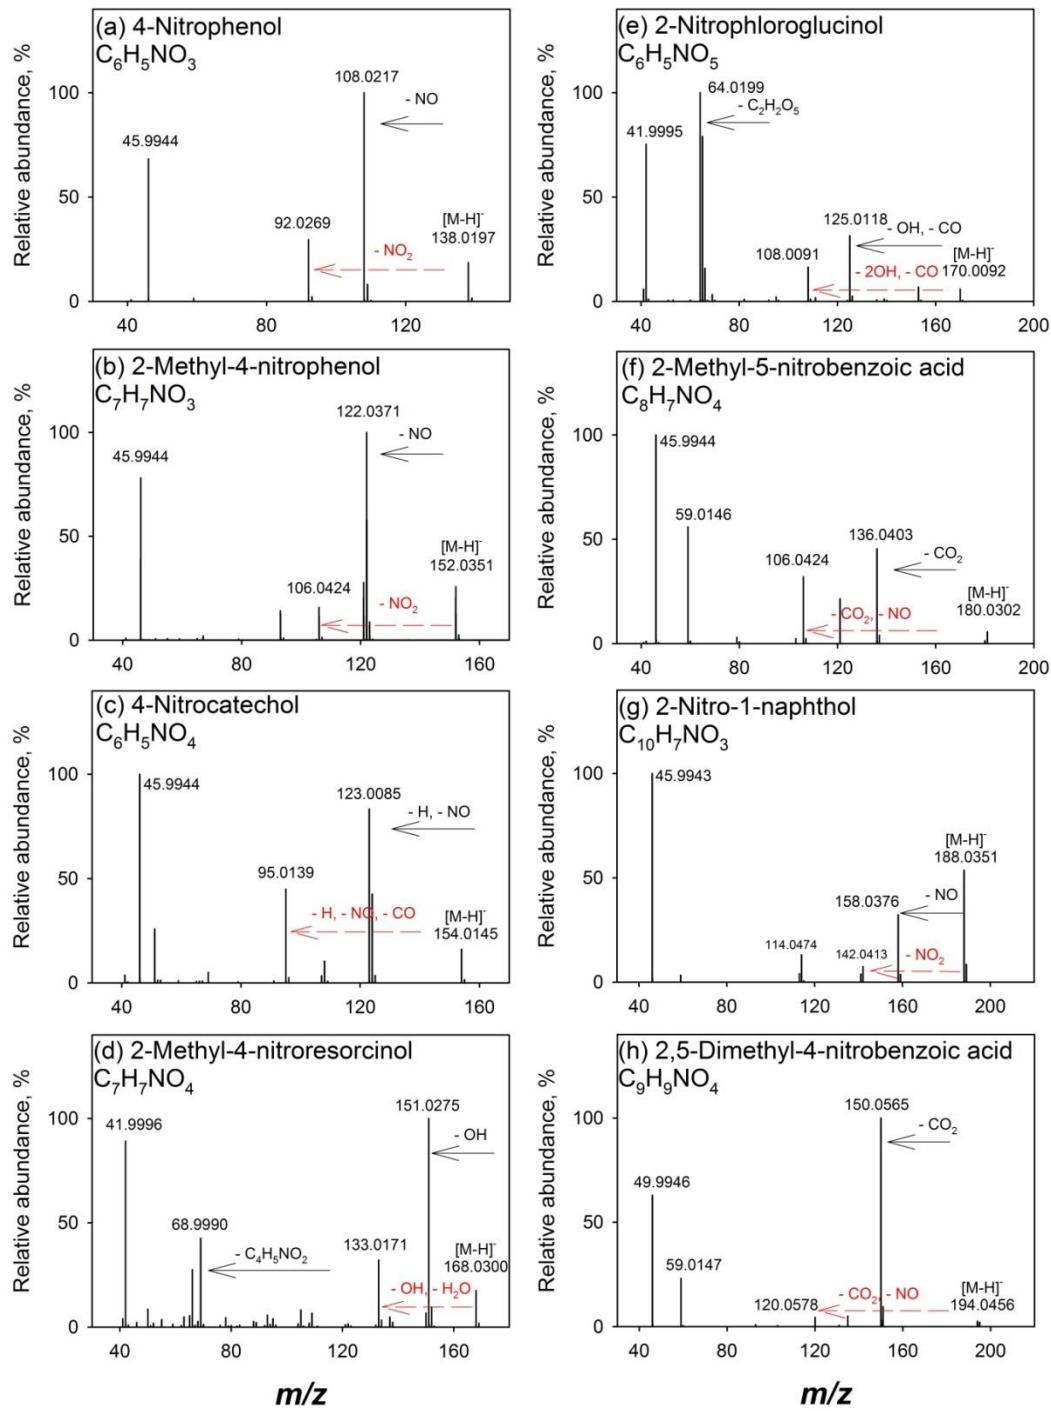


Figure S5. MS/MS spectra of standard compounds, (a) 4-nitrophenol, (b) 2-methyl-4-nitrophenol, (c) 4-nitrocatechol, (d) 2-methyl-4-nitroresorcinol, (e) 2-nitrophloroglucinol, (f) 2-methyl-5-nitrobenzoic acid, (g) 2-nitro-1-naphthol and (h) 2,5-dimethyl-4-nitrobenzoic acid (Xie et al., 2017); mass spectra of (i) phenyl cyanate, (j) benzoxazole, (k) 4-methoxyphenyl isocyanate, and (l) 2,4-dimethoxyphenyl isocyanate with EI mode (Xie et al., 2019); MS/MS spectra of (e) 4-methoxyphenyl isocyanate and (f) 2,4-dimethoxyphenyl isocyanate with ESI positive ion mode (Xie et al., 2019).

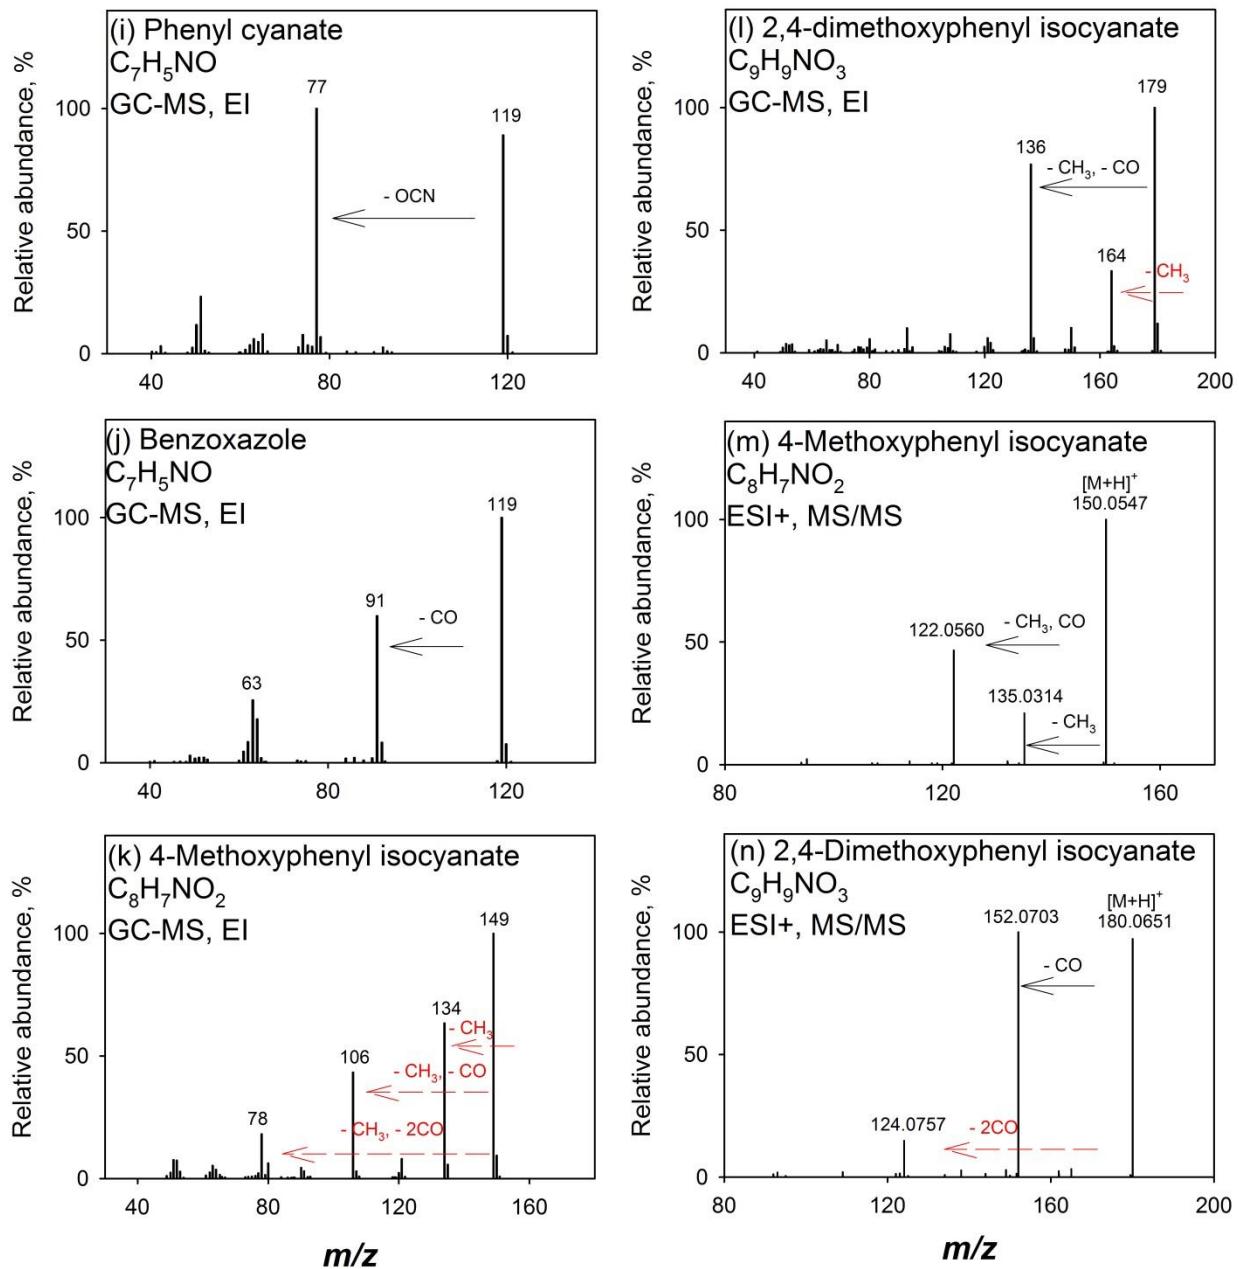


Figure S5. Continued

References

- Chen, Y., and Bond, T. C.: Light absorption by organic carbon from wood combustion, *Atmospheric Chemistry and Physics*, 10, 1773-1787, 10.5194/acp-10-1773-2010, 2010.
- Hecobian, A., Zhang, X., Zheng, M., Frank, N., Edgerton, E. S., and Weber, R. J.: Water-Soluble Organic Aerosol material and the light-absorption characteristics of aqueous extracts measured over the Southeastern United States, *Atmospheric Chemistry and Physics*, 10, 5965-5977, 10.5194/acp-10-5965-2010, 2010.
- Liu, J., Bergin, M., Guo, H., King, L., Kotra, N., Edgerton, E., and Weber, R. J.: Size-resolved measurements of brown carbon in water and methanol extracts and estimates of their contribution to ambient fine-particle light absorption, *Atmospheric Chemistry and Physics*, 13, 12389-12404, 10.5194/acp-13-12389-2013, 2013.
- NIOSH, 1999. National Institute of Occupational Safety and Health. Elemental carbon (diesel particulate): Method 5040, Rep. <https://www.cdc.gov/niosh/docs/2003-154/pdfs/5040f3.pdf> (1999). Accessed July, 2017.
- Xie, M., Chen, X., Hays, M. D., Lewandowski, M., Offenberg, J., Kleindienst, T. E., and Holder, A. L.: Light absorption of secondary organic aerosol: Composition and contribution of nitroaromatic compounds, *Environmental Science & Technology*, 51, 11607-11616, 10.1021/acs.est.7b03263, 2017.
- Xie, M., Shen, G., Holder, A. L., Hays, M. D., and Jetter, J. J.: Light absorption of organic carbon emitted from burning wood, charcoal, and kerosene in household cookstoves, *Environmental Pollution*, 240, 60-67, <https://doi.org/10.1016/j.envpol.2018.04.085>, 2018.
- Xie, M., Chen, X., Hays, M. D., and Holder, A. L.: Composition and light absorption of N-containing aromatic compounds in organic aerosols from laboratory biomass burning, *Atmospheric Chemistry and Physics*, 19, 2899-2915, 10.5194/acp-19-2899-2019, 2019.